Commission of Inquiry into the CFMEU and Misconduct in the Construction Industry

Hearing Week 17 – Cross River Rail

WHSQ Notices Bundle

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002403

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CLIFTON PRODUCTIONS PTY LTD AS TRUSTEE FOR CLIFTON PRODUCTIONS

ABN: | ACN:

Trading as:

Address: 15 DUNSTANS CT, THOMASTOWN 3074 VIC

Details of contravention:

Site location

RNA SHOWGROUNDS, 600 GREGORY , BOWEN HILLS 4006 QLD

I, John Barber reasonably believe on 12-NOV-2019 at 11:26 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 43(2)

Brief description of how the provision is being or has been contravened:

Clifton Productions as trustee for Clifton Productions must not direct or allow a worker to carry out work at a workplace if a regulation requires the work, or class of work, to be carried out by, or on behalf of, a person who is authorised, and the person, or the person on whose behalf the work is to be carried out, is not authorised under a regulation.
I observed workers installing steel bracing and roof tracking for roof of the stage. After discussions with the workers, it was determined that the work they were performing was rigging work. Observed licences of workers. The workers did not hold the appropriate rigging licence or was under a training program to be a basic rigger.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

12-NOV-2019
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 19-NOV-2019

Service method: Delivered directly to the person named by electronic transmission

WAYNE SKALS
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002403

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2022488

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: AUSTRALASIAN TECHNICAL SERVICES (QLD) PTY LTD

ABN: 41122294991 | ACN: 122294991

Trading as:

Address: 28 , 17 CAIRNS ST, LOGANHOLME DC 4129 QLD

Details of contravention:

Site location

Lot 2, 83-109 Albert St, Brisbane City
Albert Street Station - Cross River Rail

I, John Azcune reasonably believe on 22-NOV-2019 at 08:45 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 460(2)

Brief description of how the provision is being or has been contravened:

Australasian Technical Services (QLD) Pty Ltd as a licensed removalist have failed to provide appropriate training to a worker carrying out licensed asbestos removal work at a workplace to ensure that the work is carried out in accordance with the asbestos removal control plan for the workplace.
I formed a reasonable belief that workers were removing bitumen membrane from concrete parapet which I reasonably believe was contaminated with an asbestos containing material known as neurolite. I observed workers not wearing appropriate PPE (work clothes no RPE, etc). My conversation with Lloyd Kiel revealed that the work was not being conducted in accordance with the asbestos removal control plan. The asbestos removal control plan requires your workers to wet the area, wear type 5 disposable overalls and P2 half face respirators. All workers conducting the work has signed onto the ARCP and this activity is a licenced asbestos removal work because they are removing approx. 200 lineal metres

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Follow the asbestos removal control plan.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

22-NOV-2019 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before:	Service method:
23-NOV-2019	Delivered directly to the person named by electronic transmission
LLOYD KIEL	Management Representative For Person With Management Or Control Of A Workplace
Notice given to	Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2022488

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Improvement notice

Notice No. I2022488

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12
V1.1.12

RECIPIENT'S COPY

Queensland Government

ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice No. P1026209

Notice issued to:

Legal name of person/business or undertaking: AUSTRALASIAN TECHNICAL SERVICES (QLD) PTY LTD

ABN: 41122294991 | ACN: 122294991

Trading as:

Address: 28 , 17 CAIRNS ST, LOGANHOLME DC 4129 QLD

Details of serious risk:

Site location | Direction given orally: Y

Lot 2, 83-109 Albert St, Brisbane City 4000.
Albert Street Station - Cross River Rail

I, John Azcune reasonably believe on 22-NOV-2019 at 08:45 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(A), 32
Work Health and Safety Regulation 2011 - regulation 420(1)

I direct the person with control over the following activity to stop the activity of: conducting asbestos removal work, being asbestos bitumen membrane removal from concrete parapet, where there is no controls in place

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

My conversation with Lloyd Kiel indicated that workers had begun removing contaminated bituminous material and mortar as a trial, which is contaminated with a product which I reasonably believe to be neurolite, or an asbestos containing material. The asbestos register for the site confirms that the product is an asbestos containing material. I observed workers who were not wearing any personal protective equipment in accordance with your asbestos removal control plan. I formed a reasonable belief that these workers were removing the asbestos containing material without adequate controls in place to manage the risk of exposure to asbestos. This was based on my observation of the workers, my review of the ARCP and my conversation with Lloyd Kiel. I also observed the material which had been removed on the immediate area and floor below. Failure to manage the risk of exposure may result in imminent or immediate exposure which could result in a serious illness.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Clean up affected area, vacuum using H class vacuum fitted with a HEPA filter and proceed work only after hygienist provides clearance.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

22-NOV-2019 | [redacted]
Date issued | Inspector's location

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.worksafe.qld.gov.au/.

Service method:

Delivered directly to the person named by electronic transmission	
LLOYD KIEL	Management Representative For Person With Management Or Control Of A Workplace
Notice given to	Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2022489

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DECC ENVIRONMENTAL PTY LTD

ABN: 76169336725 | ACN: 169336725

Trading as:

Address: 14 , 15 CORPORATE PL, HILLCREST 4118 QLD

Details of contravention:

Site location

Demolition area

I, John Azcune reasonably believe on 03-DEC-2019 at 13:28 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

PCBU has not ensured so far as reasonably practicable that a safe system of work is in place when removing ACM. I observed in the Work Method Statement [WMS] that no consideration for foot wear to be decontaminated when leaving site that is potentially contaminated with an asbestos product. I observed an area that had performed ACM removal at a demolition site, which had not had a clearance certificate to confirm that ACM was clear from the work area were workers could gain access.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

03-DEC-2019 Date issued | [redacted] Inspector's location

This contravention must be remedied before: 05-DEC-2019

Service method: Delivered directly to the person named by electronic transmission

MICHEL ITEL — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2022489

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002890

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: X-CEL CONSTRUCTION SERVICES PTY LTD

ABN: 82168493105 | ACN: 168493105

Trading as:

Address: 111 RAILWAY AV, STRATHPINE 4500 QLD

Details of contravention:

Site location

Albert Street Station, Albert Street Brisbane 4000

I, Paul Watts reasonably believe on 04-DEC-2019 at 08:35 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

I have observed and photographed workers on a mobile scaffold which has been checked and a hand over certificate provided by a competent person from X-Cel Construction Services Pty Ltd and I have formed a reasonable belief that the scaffold is not compliant for the following reasons where a single plank is installed with edge protection that may slide if fallen against by a person exposing the person to a fall over 2 metres, where a bottom rail has not been installed on 1 side and where there is no bracing on the lower half of one side of the scaffold. I believe the fact that no plan is provided for the erection of the scaffold is a contributing factor to the breach.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person who conducts a business or undertaking involving inspection and hand over of scaffold must ensure so far as reasonably practicable that any scaffold that is inspected and a hand over certificate provided by the company is compliant prior to providing a hand over for use by any person

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

04-DEC-2019 Date issued | [redacted] Inspector's location

This contravention must be remedied before: 06-DEC-2019

Service method: Delivered directly to the person named by electronic transmission

RICHARD PEARSON
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002890

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002890

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002891

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: SUPERIOR GANTRY HIRE PTY LTD

ABN: 12609852977 | ACN: 609852977

Trading as:

Address: 50 HIGH RD, BETHANIA 4205 QLD

Details of contravention:

Site location

Albert Street Station, Albert Street Brisbane 4000

I, Paul Watts reasonably believe on 04-DEC-2019 at 08:35 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 21(2), 33

Brief description of how the provision is being or has been contravened:

I have observed and photographed workers on a mobile scaffold which has been checked and a hand over certificate provided by a competent person from X-Cel Construction Services Pty Ltd and I have formed a reasonable belief that the scaffold is not compliant for the following reasons where a single plank is installed with edge protection that may slide if fallen against by a person exposing the person to a fall over 2 metres, where a bottom rail has not been installed on 1 side and where there is no bracing on the lower half of one side of the scaffold. I believe the fact that no plan for the erection and bracing of the scaffold is provided for the erection of the scaffold by Superior Gantry Hire Pty Ltd is a contributing factor to the breach.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

A person conducting a business or undertaking must ensure so far as reasonably practicable that any fixtures fittings or plant (scaffold) under the management or control of the company are erected correctly by obtaining a documented plan for the erection of the plant and checking the plant against the plan specifications

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

04-DEC-2019 Date issued | [redacted] Inspector's location

This contravention must be remedied before: 06-DEC-2019

Service method: Delivered directly to the person named by electronic transmission

DAVID SLOANE — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002891

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002891

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2022500

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DECC ENVIRONMENTAL PTY LTD

ABN: 76169336725 | ACN: 169336725

Trading as:

Address: 14 , 15 CORPORATE PL, HILLCREST 4118 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, John Azcune reasonably believe on 29-JAN-2020 at 09:29 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

Person conducting a business or undertaking have not ensured so far as is reasonably practicable the provision and maintenance of safe plant; namely scaffold is safely maintained. I observed during the site visit that demolition debris (steel and other components) were against the structure of the scaffold in a loading area, with mobile plant which may impede the integrity of the plant.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

29-JAN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 01-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

PETROPOULOS GEORGE

Notice given to

Management Representative For Person With Management Or Control Of A Workplace

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2022500

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 24
V1.1.12

ORIGINAL

Queensland Government
ABN 13 846 673 994

Infringement notice

State Penalties Enforcement Act 1999

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or the regulations that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 1002405

Notice issued to:

Legal name of alleged offender:	DECC ENVIRONMENTAL PTY LTD
ABN: 76169336725	ACN:
Trading as (if applicable):	
Address:	14/15 CORPORATE PLACE, HILLCREST 4118
Postcode:	
Date of birth: / /	Gender: ☒ Male ☐ Female
Contact number: [redacted]	
Identification type:	ID number:

Details of alleged contravention:

Location of offence

I, REGINA WALKER (Inspector name) reasonably believe on 03/02/2020 (date) at 8.47 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☒ *Work Health and Safety Regulation 2011*, regulation 299(1)
- ☐ *Electrical Safety Act 2002*, section
- ☐ *Electrical Safety Regulation 2002*, regulation
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9001

Penalty amount $ 3600 — ***Payment must be received within 28 days after the date of this notice.***

Description of the offence:

PCBU failed to ensure that a safe work method statement for high risk construction work was prepared before the work commenced.

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

03/02/2020 — Date issued

Inspector's work address

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☒ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business

Vince Dilsalco — Notice given to

DIRECTOR/PCBU — Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

Registered Post Sender to keep
RPP44 63700 51000 43745 14608

FORM 24
V1.1.12

ORIGINAL

Queensland Government
ABN 13 846 673 994

Infringement notice

State Penalties Enforcement Act 1999

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or the regulations that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 1002406

Notice issued to:

Legal name of alleged offender: CPB CONTRACTORS PTY LIMITED
ABN: 98000893667 ACN:
Trading as (if applicable):
Address: LEVEL 6, 520 WICKHAM STREET, FORTITUDE VALLEY Postcode: 4006
Date of birth: / / Gender: ☐ Male ☐ Female Contact number [redacted]
Identification type: ID number:

Details of alleged contravention:

Location of offence
LOT 1, 96 ALBERT STREET, BRISBANE

I, REGINA WALKER (Inspector name) reasonably believe on 03/02/2020 (date) at 8.47 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

☐ *Work Health and Safety Act 2011*, section
☒ *Work Health and Safety Regulation 2011*, regulation 312
☐ *Electrical Safety Act 2002*, section
☐ *Electrical Safety Regulation 2002*, regulation
☐ *Safety in Recreational Water Activities Act 2011*, section
☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 8082

Penalty amount $ 2160 ***Payment must be received within 28 days after the date of this notice.***

Description of the offence:

The Principal Contractor for a construction project must take all reasonable steps to obtain a copy of the safe work method statement relating to high risk construction work before the high risk construction work commences.

Issuing inspector:

[redacted] Signature of inspector
[redacted] Inspector's ID
[redacted] Inspector's contact number
03/02/2020 Date issued
[redacted] Inspector's work address

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☒ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business

GUY McLENNAN Notice given to
SAFETY DIRECTOR Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

Registered Post Sender to keep
RPP44 63700 51000 43745 15505

PRIVACY COLLECTION STATEMENT
The Department of Justice and Attorney-General collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by The Department of Justice and Attorney-General to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Department of Justice and Attorney-General privacy information is on our website at www.justice.qld.gov.au.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2001395

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DECC ENVIRONMENTAL PTY LTD

ABN: 76169336725 | ACN: 169336725

Trading as:

Address: 14 , 15 CORPORATE PL, HILLCREST 4118 QLD

Details of contravention:

Site location

Lot 1, 96 Albert Street, Brisbane

I, Regina Walker reasonably believe on 03-FEB-2020 at 08:47 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

The PCBU did not ensure as far as is reasonably practicable the provision of and maintenance of safe systems of work. A safe system of work for high risk activity was not developed before high risk work involving the lifting of motors containing bonded asbestos containing material (ACM) commenced. It was advised further ACM work is planned.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

03-FEB-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 06-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

VINCE DILSALCO

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letter* _____ Position: _____

Signature: _____ [redacted] ate complied: / /

ABN 94 496 188 983

Notice No. I2001395

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I1033134

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: Q ELECTRICAL SERVICES PTY LTD

ABN: 70068064817 | ACN:

Trading as: Q ELECTRICAL SERVICES

Address: 37 MANTON ST, MORNINGSIDE 4170 QLD

Details of contravention:

Site location

Cross River Rail
Roma Street Station
Roma St Brisbane Q 4000

I, Peter Mundy reasonably believe on 03-FEB-2020 at 11:50 that you are contravening a provision of the:

Electrical Safety Regulation 2013 - section(s) 71(1)

Brief description of how the provision is being or has been contravened:

During a site inspection of the cribb room I observed safety switches that did not operate in all live conductors as required under AS 3012 for final sub circuits supplying socket outlets in construction sites.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Q Electrical Services Pty Ltd must ensure that all construction wiring on this site complies with the requirements of AS 3012.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-FEB-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 06-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

CLINT ASTILL — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I1033134

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004577

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 HQ SOUTH TOWER, 520 WICKHAM ST , FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

Roma Street Station, Roma St Brisbane

I, Paul Watts reasonably believe on 03-FEB-2020 at 12:15 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 43(2)

Brief description of how the provision is being or has been contravened:

I have attended the site in response to a complaint and I have listened to the complaint explained by the complainant in addition to observing the areas relevant to the complaint for emergency egress from the crib room area and from the tower crane base. I have taken photographs of the areas relevant to the complaint and I have formed a reasonable belief that CPB Contractors Pty Limited have not implemented emergency lighting and emergency signage so far as reasonably practicable to provide for emergency evacuation of the crib room and tower crane areas so far as is reasonably practicable

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person with management or control of the workplace being CPB Contractors Pty Limited must ensure that the emergency planning is reviewed and maintained with emergency lighting and emergency signage being implemented so that an evacuation can be conducted in an emergency that is without risk to persons so far as is reasonably practicable

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-FEB-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 06-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

RICHES ROB
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004577

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004577

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2001243

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 339 CORONATION DR, MILTON 4064 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD [GALLIPOLI PLACE]

I, Frank D'Allura reasonably believe on 04-FEB-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(F), 33

Brief description of how the provision is being or has been contravened:

CPB CONTRACTORS PTY LIMITED who is conducting a business or undertaking have failed to ensure, so far as is reasonably practicable the provision of any information, training, instruction or supervision in relation to the safe use of the DAVIT system that is necessary to protect all persons from risks to their health and safety arising from work carried out as part of the conduct of the business or undertaking; I attended the site in relation to a complaint and during the complaint I identified that a Davit arm is setup on the GALLIPOI PLACE pit for recovery of workers if required. During questioning of pc staff I established that there has been no relevant training or instruction in the safe use of this piece of plant. There is a likelyhood that the use of the DAVIT arm could be necessary in case of a emergency and the works in the excavation are still ongoing.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

04-FEB-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before:	**Service method:**
14-FEB-2020	Delivered directly to the person named by electronic transmission
BROGUE RINEBARGER	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2001243

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors at OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2001244

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 339 CORONATION DR, MILTON 4064 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD [GALLIPOLI PLACE]

I, Frank D'Allura reasonably believe on 04-FEB-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

CPB CONTRACTORS PTY LIMITED who is conducting a business or undertaking has failed to ensure, so far as is reasonably practicable the provision and maintenance of safe systems of work in relation to the DAVIT ARM and associated emergency equipment. I conducted a inspection of the DAVIT ARM and associated equipment as in a cranable stretcher and relevant lifting equipment. I identified that there was no inspection register in place for the equipment and the lifting equipment was overdue for inspection.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

04-FEB-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 14-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

BROGUE RINEBARGER

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2001244

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2001245

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 339 CORONATION DR, MILTON 4064 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD [GALLIPOLI PLACE]

I, Frank D'Allura reasonably believe on 04-FEB-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 300(1)

Brief description of how the provision is being or has been contravened:

CPB CONTRACTORS PTY LIMITED who are conducting a business or undertaking that includes the carrying out of high risk construction work have failed to put in place effective systems for ensuring that high risk construction work is carried out in accordance with the safe work method statement for the work. I asked questions to relevant workers and looked at the safe work method statement and looking at video footage of the activity of the excavation of the PIT and believe that the pc needs to ensure the system is effective working as required.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

04-FEB-2020 Date issued

[redacted] Inspector's location

This contravention must be remedied before: 14-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

BROGUE RINEBARGER Notice given to

Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2001245

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

FORM 24
V15.03.19

RECIPIENT'S COPY

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000011

Notice issued to:

Legal name of alleged offender: CPB Contractors Pty Limited

ABN: 98000 893 667 ACN:

Trading as (if applicable):

Address: 339 Coronation Drive, Milton - Queensland Postcode: 4064

Date of birth: / / Gender: ☐ Male ☐ Female ☐ Other Contact number:

Identification type: ID number:

Details of alleged contravention:

Location of offence

Roma Street Station - Roma Street Brisbane - Qld 4000

I, Chris O'Donnell (Enter name) reasonably believe on 4th of February 2020 (date) 12:00 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

☐ *Work Health and Safety Act 2011*, section

☑ *Work Health and Safety Regulation 2011*, regulation 300 (1)

☐ *Electrical Safety Act 2002*, section

☐ *Electrical Safety Regulation 2013*, regulation

☐ *Safety in Recreational Water Activities Act 2011*, section

☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9002

Penalty amount $ 3,600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

The person conducting the business or undertaking that includes the carrying out of high risk construction work failed to put in place arrangements for ensuring that high risk construction work is carried out in accordance with the safe work method statement for the work and that any arrangements put in place are effective on a continual basis.

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

5/02/2020 Date issued

Inspector's work address

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☑ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business

☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Brogue RINEBARGER Notice given to

Management Representative Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 65 959 415 151

Queensland Government

What to do next

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued.

If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, [redacted] Family [redacted]

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004583

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: AVOPILING (QLD) PTY LTD

ABN: 42142842644 | ACN: 142842644

Trading as:

Address: 4 COMMERCE CT, CLONTARF 4019 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 11-FEB-2020 at 14:40 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 306D(4)

Brief description of how the provision is being or has been contravened:

i have observed and photographed a tremy rack with a single chain that is able to be latched across the access way when a person is working on the tremy rack platform to prevent a fall over 2 metres from the platform and I have identified that the single chain does not comply with the requirements of work health and safety regulations to manage the risk of falls over 2 metres where Avopiling (Qld) Pty Ltd are conducting a business or undertaking

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Avopiling (Qld) Pty Ltd must redesign the tremy rack so that the company implements a safe system of work that complies with the work health and safety regulations as edge protection to manage the risk of falls over 2 metres from the tremy rack work platform

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Refer to the managing risk of falls at a workplace 2018 code of practice

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

11-FEB-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before:	**Service method:**
18-FEB-2020	Delivered directly to the person named by electronic transmission
CALE WELLS Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004583

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004584

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: EAST COAST CRANES PTY LTD

ABN: 41619544240 | ACN: 619544240

Trading as:

Address: 64 BURNSIDE RD, YATALA 4207 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 11-FEB-2020 at 14:18 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 346(1)

Brief description of how the provision is being or has been contravened:

I have attended site and walked the site area in company of the principal contractor and representatives of the CFMMEU and I have made observations and taken photographs on site where a can of Tel-x Plus has been identified which based on the information on the can is a hazardous chemical and refers to user to a safety data sheets and I made enquiries to identify that East Coast Cranes Pty Ltd does not have a safety data sheet available as a part of their hazardous chemicals register and I have formed a reasonable belief that the company is not in compliance with work health and safety regulation 346(1)

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

East Coast Cranes Pty Ltd must ensure that a hazardous chemicals register is developed and is reasonably available to workers that contains safety data sheets for products that meet the criteria of a hazardous chemical to be in compliance with work health and safety regulation 346(1)

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

11-FEB-2020 Date issued | [redacted] Inspector's location

This contravention must be remedied before: 18-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

PETER AUSTIN
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004584

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004584

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004585

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: EAST COAST CRANES PTY LTD

ABN: 41619544240 | ACN: 619544240

Trading as:

Address: 64 BURNSIDE RD, YATALA 4207 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 11-FEB-2020 at 14:30 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 302

Brief description of how the provision is being or has been contravened:

I have observed and photographed a safe work method statement presented to me by East Coast Cranes Pty Ltd while making enquiries at the workplace after a complaint by the CFMMEU and I have identified that the system of work for installation of crane counterweights on the 130 T Liebherr crane has been reviewed in consultation with workers and union staff and a tool box talk done which has been facilitated by the principal contractor at the site with the amended procedure and I have formed a reasonable belief that East Coast Cranes Pty Ltd has failed to review and revise the safe work method statement to include the control to manage the risk of falls from the crane deck

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

East Coast Cranes Pty Ltd must review and revise the safe work method statement to include the control to manage the risk of falls from the crane deck which is over 2 metres

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Refer to the managing risk of falls at a workplace code of practice 2018

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

11-FEB-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 14-FEB-2020

Service method: Delivered directly to the person named by electronic transmission

MICHAEL AUSTIN — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004585

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2012770

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD	

Details of contravention:

Site location

Lot 2, Cnr Albert & Mary Street Cross River Rail site, Brisbane

I, Paul Kitchener reasonably believe on 11-FEB-2020 at 14:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

I observed and photographed an entry walkway into the site for workers on foot. The walkway accessed into the worksite and also was delineated to an amenities area which included a site toilet. There was a significant amount of water and mud restricting safe access/egress to the area, and also a significant amount of water and mud restricting access to the toilet. The conditions present a risk to the health and safety of workers from injuries due to slips, trips and falls.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A PERSON CONDUCTING A BUSINESS OR UNDERTAKING AT A WORKPLACE MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THE FOLLOWING- (A) THE LAYOUT OF THE WORKPLACE ALLOWS, AND THE WORKPLACE IS MAINTAINED SO AS TO ALLOW, FOR PERSONS TO ENTER AND EXIT AND TO MOVE ABOUT WITHOUT RISK TO HEALTH AND SAFETY, BOTH UNDER NORMAL WORKING CONDITIONS AND IN AN EMERGENCY;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]		
Signature of inspector	[redacted] Inspector's ID	[redacted] Inspector's contact number
11-FEB-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	Service method:
14-FEB-2020	Delivered directly to the person named by electronic transmission
MICHAEL FINCH	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: Michael Finch Position: Snr HSE Advisor

Signature: [redacted] Date complied: 12/02/20

ABN 94 496 188 983

Notice No. I2012770

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2001250

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.

Notice issued to:

Legal name of person/business or undertaking: DELTA GROUP AUST PTY LTD	
ABN: 58000507415	ACN:
Trading as:	
Address: LEVEL 3 - 33 REMORA RD, HAMILTON 4007 QLD	

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD.WEST TOWER -

I, Frank D'Allura reasonably believe on 21-FEB-2020 at 14:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 299(1)

Brief description of how the provision is being or has been contravened:

DELTA GROUP AUST PTY LTD who is conducting a business or undertaking that includes the carrying out of high risk construction work as in demolition work has failed to ensure , before high risk construction work commences, ensure that a safe work method statement for the proposed work is prepared; I attended to a construction workplace in relation to a incident where a piece of sheet material narrowly missing 2 workers when it fell from the the building. Through the investigation process I have established that the SWMS that was in use didn't identify or manage the falling objects risks that were present. I conducted a inspection to the work area where the incident happened and observed a open area where the man and material hoist is to be installed. The controls in place only included a one meter scaffold handrail system with brick guards. The position of the wall that fell over is next to the opening. I also observed open windows that have no system to manage falling objects.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted]	[redacted]	
Signature of inspector	Inspector's ID	Inspector's contact number
21-FEB-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	**Service method:**
28-FEB-2020	Delivered directly to the person named by electronic transmission
PAUL RYAN	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2001250

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: PAUL RYAN Position: PROJECT MANAGER

Signature: [redacted] Date complied: 27/12/2020


ABN 94 496 188 963

Notice No. I2001250

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

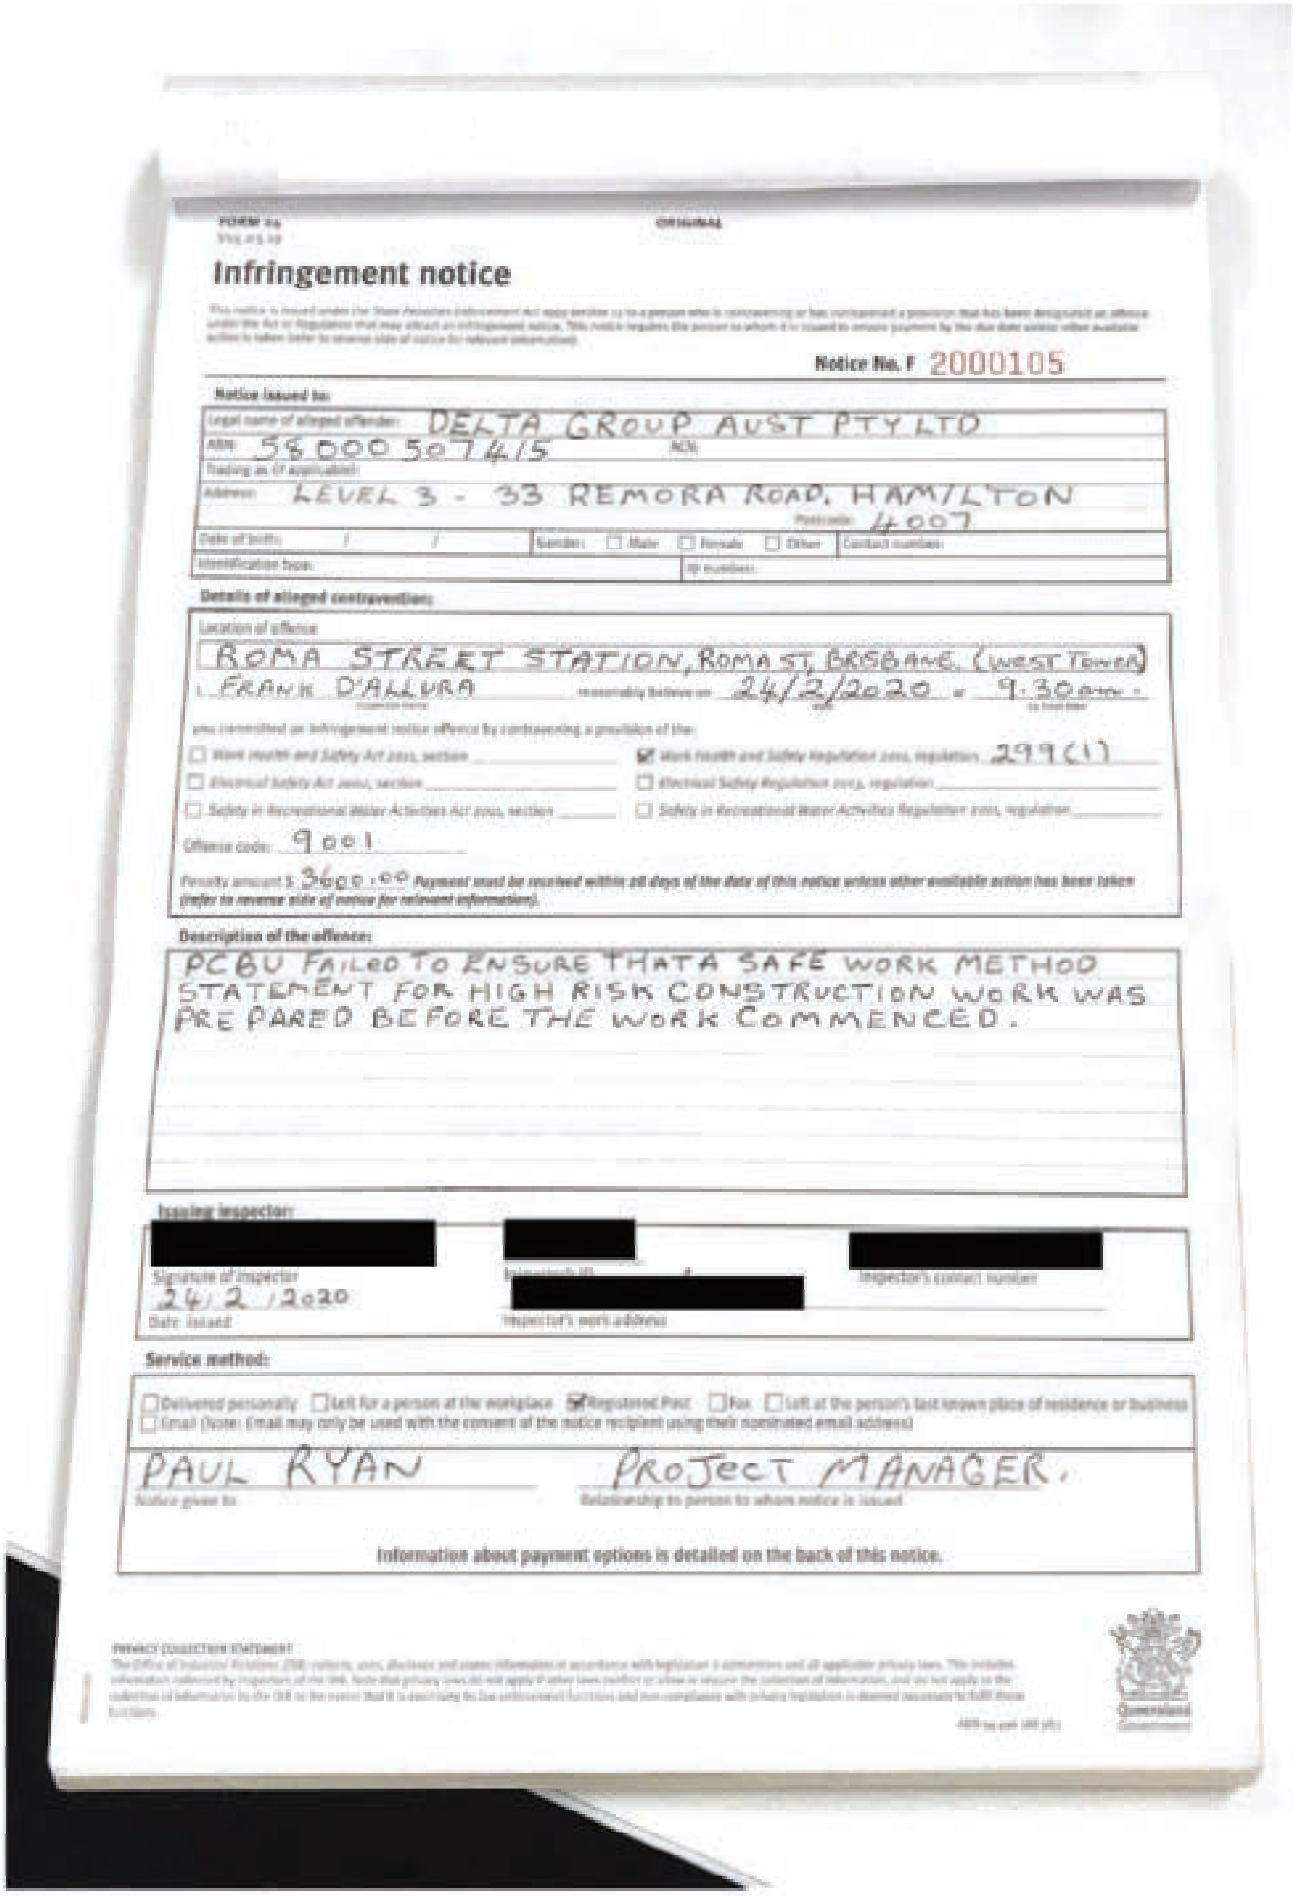

FORM 24
V15.01.19

ORIGINAL

Infringement notice

This notice is issued under the *State Penalties Enforcement Act* 1999 section 23 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000105

Notice issued to:

Legal name of alleged offender:	DELTA GROUP AUST PTY LTD
ABN: 58 000 507 415	ACN:
Trading as (if applicable):	
Address:	LEVEL 3 - 33 REMORA ROAD, HAMILTON
	Postcode: 4007
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other
Contact number:	
Identification type:	ID number:

Details of alleged contravention:

Location of offence:
ROMA STREET STATION, ROMA ST, BRISBANE. (WEST TOWER)

I, FRANK D'ALLURA (Inspector name) reasonably believe on 24/2/2020 (date) at 9:30 am/pm (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☑ *Work Health and Safety Regulation 2011*, regulation 299(1)
- ☐ *Electrical Safety Act 2002*, section
- ☐ *Electrical Safety Regulation 2013*, regulation
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9001

Penalty amount: $ 3600.00 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

PCBU FAILED TO ENSURE THAT A SAFE WORK METHOD STATEMENT FOR HIGH RISK CONSTRUCTION WORK WAS PREPARED BEFORE THE WORK COMMENCED.

Issuing inspector:

[redacted] [redacted] [redacted]

Signature of inspector

24/2/2020
Date issued

[redacted]
Inspector's work address

Inspector's contact number

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☑ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

PAUL RYAN
Notice given to

PROJECT MANAGER.
Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislative requirements and all applicable privacy laws. This includes information collected by Inspectors of the OIR. Note that privacy laws do not apply if other laws confirm or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 66 329 169 412

Queensland Government

BOOK COPY

FORM 24

What to do next

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued. If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, [redacted] [redacted]
Given name/s Family name

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Details of CFMEU Workplace Health and Safety Queensland Incidents

Date of Notice	24/02/2020
Notice Number	F1000105
Location	Roma St Station
Incident Description	No SWMS for High-Risk Construction
Issued By	Frank D'Allura

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004712

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: AVOPILING (QLD) PTY LTD

ABN: 42142842644 | ACN: 142842644

Trading as:

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD - Lot 2

I, Christopher O'Donnell reasonably believe on 27-FEB-2020 at 11:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 21(2), 33
Work Health and Safety Regulation 2011 - regulation 203

Brief description of how the provision is being or has been contravened:

I observed and photographed an excavator with Avopiling signage being used as a crane to lift sections of pipe. The operator was unfamiliar with the location of the load chart or the de-rated lifting capacity of the excavator.
I further observed the chains used to lift the sections of pipe were not correctly attached with the wider side of hook not supporting the load. Conversation with the operator revealed he was not aware of the weight of the load he was lifting at the time of inspection.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

27-FEB-2020 — Date issued

[redacted] — Inspector's location

This contravention must be remedied before: 05-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

CJ MANJARRES-WAHLBERG — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004712

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004713

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: AVOPILING (QLD) PTY LTD

ABN: 42142842644 | ACN: 142842644

Trading as:

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD - Lot 2

I, Christopher O'Donnell reasonably believe on 27-FEB-2020 at 11:00 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(F), 33

Brief description of how the provision is being or has been contravened:

The PCBU has failed to ensure so far as is reasonably practicable that the information provided to workers in relation to the Personal Protective Equipment (PPE) required to be worn while on site is sufficient to protect all persons from risks to their health and safety arising from work carried out as part of the conduct of the business or undertaking.

I observed and photographed worded messages used to accompany a sign requiring mandatory action. The worded message does not require a mandatory action or prohibit an action, and conflicts with the Blue and White signs that indicate that an instruction must be carried out. This generates confusion, especially if the workers are required to work on other construction sites that use the mandatory PPE where failure to wear the PPE could result in serious injuries.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

27-FEB-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 27-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

CJ MANJARRES-WAHLBERG
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004713

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12
V1.1.12

RECIPIENT'S COPY

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice No. P1023228

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 339 CORONATION DR, MILTON 4064 QLD

Details of serious risk:

Site location | Direction given orally: Y

ROMA STREET STATION, ROMA ST, BRISBANE CITY [ROMA STREET TUNNEL SHAFT]

I, Frank D'Allura reasonably believe on 28-FEB-2020 at 15:15 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

I direct the person with control over the following activity to stop the activity of: of allowing workers to access and perform construction work in the ROMA STREET TUNNEL SHAFT until the access into and out off is safe to use and appropriate for the amount of workers who are working in the shaft.

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I attended the construction workplace in relation to a complaint about inadequate safe access into and out of the Roma street tunnel shaft. I was provided with video footage which showed 8 workers working in the shaft erecting scaffold. I observed the access into the shaft is via a scaffold system with a adjustable stretcher stair system proving the access to the shaft. I observed that the stair system is sitting on a plywood step which is sitting on a mound of earth at least 3m high. The sitting of the plywood step on the uncompacted mound of earth is unstable. The stair system is installed over 45 degrees and stair going is leaning forward and not installed as per the design limits. Workers who were using the system were exposed to fall risks as fall issues were not being managed on the earth ramp in the bottom of the excavation. The access which was provided to workers to use is potentially exposing the workers to the risk of a serious injury or death.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

02-MAR-2020 | [redacted]

Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

BARRY STEWART | Management Representative For Person With Management Or Control Of A Workplace

Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.worksafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2012783

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CAPORN FOUNDATIONS PTY LTD

ABN: 12130900604 | ACN: 130900604

Trading as:

Address: 306 DUFFIELD RD, CLONTARF 4019 QLD

Details of contravention:

Site location

BOGGO RD CROSS RIVER RAIL SITE - 30 JOE BAKER STREET ST, DUTTON PARK 4102 QLD

I, Paul Kitchener reasonably believe on 11-MAR-2020 at 10:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 21(2), 32

Brief description of how the provision is being or has been contravened:

I observed and photographed a crane man cage which had a non functioning lock (stuck in closed position) and a broken strand of wire mesh in the door. The item of plant presents the risk to the health and safety of persons at the workplace.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

THE PERSON WITH MANAGEMENT OR CONTROL OF FIXTURES, FITTINGS OR PLANT AT A WORKPLACE MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THAT THE FIXTURES, FITTINGS AND PLANT ARE WITHOUT RISKS TO THE HEALTH AND SAFETY OF ANY PERSON.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

11-MAR-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 14-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

SAM KELLY
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2012783

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013172

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CAPORN FOUNDATIONS PTY LTD

ABN: 12130900604 | ACN: 130900604

Trading as:

Address: 306 DUFFIELD RD, CLONTARF 4019 QLD

Details of contravention:

Site location

30 Joe Baker Street Dutton Park

I, Noel Hayes reasonably believe on 11-MAR-2020 at 10:30 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 21(2), 33

Brief description of how the provision is being or has been contravened:

The PCBU has not ensured that the retaining pin used to prevent the kelly pin from removal is in accordance with the manufacturers specifications.

I observed and photographed two bolts welded together to create a retainer to secure the kelly pin. There is an absence of any documentation to support the use of any other retainer other than whats recommended

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

THE PERSON WITH MANAGEMENT OR CONTROL OF FIXTURES, FITTINGS OR PLANT AT A WORKPLACE MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THAT THE FIXTURES, FITTINGS AND PLANT ARE WITHOUT RISKS TO THE HEALTH AND SAFETY OF ANY PERSON.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] Inspector's ID | [redacted] Inspector's contact number

11-MAR-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 13-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

SAM KELLY
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013172

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

FORM 24
V15.03.10

ORIGINAL

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000412

Notice issued to:

Legal name or alleged offender: X-CEL CONSTRUCTION SERVICES PTY LTD

ABN: 82 168 493 705 ACN:

Trading as (if applicable):

Address: 111 RAILWAY AV, STRATHPINE Postcode: 4500

Date of birth: / / Gender: ☐ Male ☐ Female ☐ Other Contact number:

Identification type: ID number:

Details of alleged contravention:

Location of offence: 96 ALBERT STREET, BRISBANE, 4000

I, ANTONY LADDEN (Inspector name) reasonably believe on 17-3-2020 (date) at 0910 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

☐ *Work Health and Safety Act 2011*, section

☑ *Work Health and Safety Regulation 2011*, regulation 299(1)

☐ *Electrical Safety Act 2002*, section

☐ *Electrical Safety Regulation 2013*, regulation

☐ *Safety in Recreational Water Activities Act 2011*, section

☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9001 & PTO*

Penalty amount $ 3600 *Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).*

Description of the offence:

A PERSON CONDUCTING A BUSINESS OR UNDERTAKING THAT INCLUDES THE CARRYING OUT OF HIGH RISK CONSTRUCTION WORK (CARRIED OUT IN AN AREA THAT MAY HAVE A CONTAMINATED ATMOSPHERE) MUST BEFORE HIGH RISK CONSTRUCTION WORK COMMENCES ENSURE THAT A SAFE WORK METHOD STATEMENT IS PREPARED.

[redacted] (Signature of inspector) [redacted] (Authorised by) [redacted] (Inspector's work address)

Date issued: 19 / 3 / 2020

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☑ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

RICHARD PEARSON (Notice given to) MANAGING DIRECTOR (Relationship to person to whom notice is issued)

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR), and its contractors, collects personal information in accordance with legislative requirements and the Information Privacy Act 2009. The personal information collected by inspectors of the OIR will be used for the purpose of administering the legislation for which they are responsible. Personal information may be disclosed to other government agencies, courts and tribunals, and may be accessed by the person to whom it relates under the Right to Information Act 2009 and Information Privacy Act 2009.

Queensland Government

What to do next

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued. If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, RICHARD IVAN PEARSON
Given name/s Family name

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: [redacted] Date: 18-3-20

Current address: [redacted]

_____

Contact phone number [redacted] Infringement notice number: 2000412

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2005736

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

96 Albert Street, Brisbane, 4000

I, Antony Lackey reasonably believe on 12-MAR-2020 at 13:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 20(2), 33

Brief description of how the provision is being or has been contravened:

Failure to ensure so far as is reasonably practicable the health and safety of any persons. I observed, noted and photographed the gantry over the Alberts Street public walkway was leaking in four locations giving rise to risk of slips, trips or falls.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

WHS Regulation 315k (2) the gantry must be able to stop water or dust falling on a persons.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

12-MAR-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 19-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

MARK TAYLOR — Notice given to

Management Representative For Person With Management Or Control Of A Workplace — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2005736

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1023314

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of serious risk:

Site location — Direction given orally: Y

96 Albert Street, Brisbane, 4000

I, Antony Lackey reasonably believe on 12-MAR-2020 at 13:00 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 20(2), 32

I direct the person with control over the following activity to stop the activity of: Using the northern gantry access stairs on Albert Street with risk of collapse.

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

Failure to ensure so far as is reasonably practicable the means of entering and exiting namely the Albert Street gantry northern stairs are with out risk to health and safety of any person. I observed, noted and photographed the top stingers/ stairs at the northern end of the Albert Street gantry was missing connecting/ linking fixings. The stairs were only restrained by a tek screw through the top plate and hand rails.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

12-MAR-2020 | [redacted]
Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

MARK TAYLOR | Management Representative For Person With Management Or Control Of A Workplace
Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002826

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 339 CORONATION DR, MILTON 4064 QLD	

Details of contravention:

Site location

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Frank D'Allura reasonably believe on 16-MAR-2020 at 15:44 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(F), 33

Brief description of how the provision is being or has been contravened:

CPB CONTRACTORS PTY LIMITED who is conducting a business or undertaking has failed to ensure, so far as is reasonably practicable the provision of any information, training, instruction or supervision that is necessary to protect all persons from risks to their health and safety arising from work carried out as part of the conduct of the business or undertaking: I attended the construction workplace and observed work areas where crowd barriers are being used as edge protection in multiple work areas where falls exist. The crowd barrier system is not 2m away from the fall issues identified. Also empty water barriers are being used as some form of edge protection in certain areas. I had a discussion with contractor who advised he supplies some of the system as well as pc and he was unaware that the system can't be used as edge protection. The site supervisors on site should of advised workers of the correct installation process and the correct choice of control to use.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

16-MAR-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before:	**Service method:**
20-MAR-2020	Delivered directly to the person named by electronic transmission
JERRY KARATI Notice given to	Management Representative For Person With Management Or Control Of A Workplace Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002826

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002826

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12
V1.1.12

RECIPIENT'S COPY

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government

ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1023229

Notice issued to:

Legal name of person/business or undertaking: FORMCON GROUP PTY LTD

ABN: 75201056676 | ACN: 125757057

Trading as:

Address: 67 ENKLEMAN RD, YATALA 4207 QLD

Details of serious risk:

Site location | Direction given orally: Y

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Frank D'Allura reasonably believe on 16-MAR-2020 at 10:15 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(F), 32
Work Health and Safety Regulation 2011 - regulation 78(1)

I direct the person with control over the following activity to stop the activity of: allowing workers to access and perform construction work in areas where there is inadequate controls in place to manage the risk of falls.

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I attended the construction workplace and observed areas where pcbu's workers have been working where the controls used to manage falls into excavations are not adequate or engineer designed to prevent a fall into the excavations. I questioned supervisor about the system being used and he was unaware that the control being used is a visual barrier and can't be used near edge of excavation. The use of water barriers was being implemented also but no water in units and units placed near edges also. The issue of the fall preventive controls being installed outside of the manufactures recommendations is exposing workers to a risk of serious injury if the worker would fall against it as the system would most likely fail.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

17-MAR-2020 | [redacted]

Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

MURRAY HARRIS | Management Representative For Person Conducting A Business Or Undertaking

Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.worksafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2005737

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: X-CEL CONSTRUCTION SERVICES PTY LTD

ABN: 82168493105 | ACN: 168493105

Trading as:

Address: 111 RAILWAY AV, STRATHPINE 4500 QLD

Details of contravention:

Site location

96 Albert Street

I, Antony Lackey reasonably believe on 17-MAR-2020 at 13:15 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Regulation 2011 - regulation 299(1)

Brief description of how the provision is being or has been contravened:

Failure to ensure before the high risk construction work commences that a work method statement for the proposed work namely dismantling of scaffolding carried out in area that may have a contaminated atmosphere (concrete dust). I observed, noted, photographed and video of scaffolders dismantling scaffolding that was use as a perimeter containment screening during demolition of a concrete structure/ building, workers were removing scaffold components above there heads and dust was present. The current safe work method statement didn't state the hazards and risks or control measures to be implemented to control the risks to health and safety of workers in a contaminated atmosphere.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

WHS Regulation 299 (2)
safe work method statement must¿
(a) identify the work that is high risk construction work;
and
(b) state hazards relating to the high risk construction work and risks to health and safety associated with those hazards;
and
(c) describe the measures to be implemented to control the risks; and
(d) describe how the control measures are to be implemented, monitored and reviewed.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

If a Safe Work Method Statement is lacking one or more of the aforementioned elements of regulation 299 (2) A to D it does not constitute a Safe Work Method Statement, therefore the Person Conducting a Business or Undertaking has failed to ensure that a Safe Work Method Statement for High Risk Construction Work was prepared before the work commenced.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

18-MAR-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 23-MAR-2020

Service method: Delivered directly to the person named by electronic transmission

RICHARD PEARSON | Management Representative For Person Conducting A Business Or Undertaking

Notice given to | Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2005737

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2005737

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 24
V15.03.19

RECIPIENT'S COPY

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2011059

Notice issued to:

Legal name of alleged offender:	BOM INTERNATIONAL AUSTRALIA PTY LTD, CPB CONTRACTORS		
ABN: 80 900 474 424	ACN: 44 LIMITED-GILLIES PTY LTD, UGL ENGINEERING PTY LIMITED		
Trading as (if applicable):			
Address: JOE BAKER ST DUTTON PARK			
		Postcode:	
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other	Contact number:	
Identification type:	ID number:		

Details of alleged contravention:

Location of offence: BOGGO ROAD STATION

I, GARY MATHESON (inspector name) reasonably believe on 15/04/2020 (date) at 1058 HRS (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☑ *Work Health and Safety Act 2011*, section _____
- ☑ *Work Health and Safety Regulation 2011*, regulation 346 (1)
- ☐ *Electrical Safety Act 2002*, section _____
- ☐ *Electrical Safety Regulation 2013*, regulation _____
- ☐ *Safety in Recreational Water Activities Act 2011*, section _____
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation _____

Offence code: 9011

Penalty amount $ 3600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

(a) PCBU FAILED TO ENSURE THAT A REGISTER OF HAZARDOUS CHEMICALS USED, HANDLED OR STORED AT THE WORKPLACE IS PREPARED AND KEPT AT THE WORKPLACE

(b) PCBU FAILED TO ENSURE THAT THE REGISTER OF HAZARDOUS CHEMICALS IS MAINTAINED SO THAT THE INFORMATION IN THE REGISTER IS UP TO DATE

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

16/4/20 Date issued

[redacted] Inspector's work address

Service method:

☑ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

PETER CULLEN — Notice given to

SAFETY ADVISOR — Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 94 496 420 583

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2023095

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CPB CONTRACTORS PTY LIMITED	
Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD	

Details of contravention:

Site location

867 MAIN STREET, WOOLLOONGABBA Q 4102

I, ANTHONY WATEGO reasonably believe on 21-APR-2020 at 08:25 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

YOU ARE NOT ENSURING, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE SYSTEMS OF WORK.

I OBSERVED AND PHOTOGRAPHED:
* INADEQUATE PROCEDURES FOR EMERGENCY RESCUE OF INJURED PERSON/S FROM THE STATION BOX

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

21-APR-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before:	Service method:
25-APR-2020	Delivered directly to the person named by electronic transmission
JERRY KARATI	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: JERRY KARATI Position: SENIOR SAFETY ADVISOR

Signature: [redacted] Date complied: 24/4/20

ABN 94 496 188 883

Notice No. I2023095

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013221

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: ROCKTOWN PTY LTD

ABN: 18122450711 | ACN:

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY

I, Paul Kitchener reasonably believe on 23-APR-2020 at 10:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

I observed and photographed a MANITOU MRT-X-2150 Crane in operation. The operator of the crane had not undertaken a daily plant pre start check of the machine in accordance with manufacturer's specifications. A Pre-Lift Start card indicated that the operator had undertaken:
'All OEM pre-start checks/inspections'. The Cross River Rail Plant Pre Start had been last completed on 22 April, 2020, and there was no current entry in the EZYQUIP Hire Operators Daily Plant Maintenance Checklist. You have not ensured, so far as reasonably practicable, that the plant has been provided without risks to persons.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Act 2011 - section 19(3)(B)
WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE PLANT AND STRUCTURES

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

23-APR-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 27-APR-2020

Service method: Delivered directly to the person named by electronic transmission

JOHN MCCAUGHEY

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013221

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: __JOHN McCAUGHEY_____ Position: Project Manager QLD_____

Signature: _[redacted] Date complied: 26 /04 /2020

ABN 94 496 188 983

Notice No. I2013221

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2023094

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: **CPB CONTRACTORS PTY LIMITED**	
Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD	

Details of contravention:

Site location

867 MAIN STREET, WOOLLOONGABBA Q 4102

I, ANTHONY WATEGO reasonably believe on 21-APR-2020 at 08:25 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

YOU ARE NOT ENSURING, SO FAR AS IS REASONABLY PRACTICABLE, THE WORKPLACE (NAMELY STATION BOX) IS MAINTAINED SO AS TO ALLOW, FOR PERSONS TO ENTER AND EXIT AND TO MOVE ABOUT WITHOUT RISK TO HEALTH AND SAFETY, BOTH UNDER NORMAL WORKING CONDITIONS AND IN AN EMERGENCY.

I OBSERVED AND PHOTOGRAPHED:
* ABOUT 15 WORKERS IN THE AREA.
* ACCESS VIA EARTH RAMP AND SINGLE ACCESS STAIRWAY.
* ABOUT 40 METRES OF UNEVEN AND MUDDY GROUND FROM BOTTOM OF EARTH RAMP TO BOTTOM OF STAIRWAY.
* NO DELINEATION BETWEEN PLANT AND PERSONS ALONG UNEVEN SECTION OF GROUND.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

21-APR-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before:	Service method:
25-APR-2020	Delivered directly to the person named by electronic transmission
JERRY KARATI	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2023094

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in bl*: JOSH KIRATI Position: SENIOR SERGEANT LGAP

Signature: [redacted] Date complied: 24/4/20

ABN 94 496 188 983

Notice No. I2023094

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors at OIR. Note that privacy laws *do not apply if other laws restrict or allow or require the collection of information*, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013231

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CPB CONTRACTORS PTY LIMITED

Address: WOOLLOONGABBA STATION, CORNER JURGENS STREET AND LOGAN RD, WOOLLOONGABBA 4102 QLD

Details of contravention:

Site location

WOOLLOONGABBA STATION, CORNER JURGENS STREET AND LOGAN RD, WOOLLOONGABBA 4102 QLD

I, Paul Kitchener reasonably believe on 28-APR-2020 at 12:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 32

Brief description of how the provision is being or has been contravened:

I observed and photographed a document entitled 'Emergency Response & Incident Management Plan' - Revision 24 April 2020. The document relates to the emergency response procedure for the workplace, and was amended recently to reflect an Improvement Notice issued to the PCBU. The PCBU has not provided a safe system of work as since the implementation of the document, there has been no assessment by the PCBU to ascertain the effectiveness of the emergency retrieval procedure.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

30-APR-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before:	**Service method:**
02-MAY-2020	Delivered directly to the person named by electronic transmission
JERRY KARATI	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013231

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2005396

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: EAST COAST CRANES PTY LTD

ABN: 41619544240 | ACN: 619544240

Trading as:

Address: SHED 1 , 64 BURNSIDE ROAD , ORMEAU 4208 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Mark Murphy reasonably believe on 30-APR-2020 at 11:30 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

East Coast Cranes Pty Ltd who is conducting a business or undertaking have failed to ensure, so far as is reasonably practicable the provision and maintenance of safe plant. I observed and photographed steel plates and dunnage timbers that were being used to create a structure to support a drilling rig. A number of these plates had weld on lifting points attached. During conversations with a representative of the PCBU, he confirmed that the lifting points were installed without gaining engineering verification. Without engineering verification there is no guarantee to indicate that the lifting lugs and welds would safely support the load when lifted.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

01-MAY-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 15-MAY-2020

Service method: Delivered directly to the person named by electronic transmission

DAVE HOPPER
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2005396

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2023870

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

Multi-storey demountables

I, Gary Matheson reasonably believe on 01-MAY-2020 at 12:21 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 43(1)

Brief description of how the provision is being or has been contravened:

You told me and was unable to show me evidence that a system to retrieve workers working between the top and bottom of demountables in an emergency had been tested

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

01-MAY-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 05-MAY-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2023870

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1009988

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of serious risk:

Site location — Direction given orally: Y

Multi story demountables

I, Gary Matheson reasonably believe on 01-MAY-2020 at 12:06 that an activity may occur at the workplace that will involve a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is likely to be contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(1), 32
Work Health and Safety Regulation 2011 - regulation 78(1)

I direct the person with control over the following activity to stop the activity of: Of working on the multistorey demountables where there is a risk of a fall from one level to another.

until an inspector is satisfied that the matters that will give rise to the risk have been remedied.

Basis for inspector's belief:

I observed and photographed between lower demountable and middle demountable that the rails on the edge protection were more than 450mm apart and there is a risk of serious injury or death if a worker were to fall through.
There was evidence that workers had been working near the edge protection

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

01-MAY-2020 — Date issued

[redacted] — Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

PETER CULLEN — Notice given to

Management Representative For Person With Management Or Control Of A Workplace — Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002607

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD	

Details of contravention:

Site location

96 Albert Street, Brisbane, 4000, Qld

I, Antony Lackey reasonably believe on 06-MAY-2020 at 08:15 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

Failure to ensure so far as is reasonably practicable the provision and maintenance of safe system of work. I observed, noted and photographed precast concrete barriers (PCB's) being unloading with a forklift with the tines close together and at times the barrier was rocking whilst being unloaded from a truck in an exclusion zone. It was identified that the proper lifting attachments (5t clutches) weren't available onsite yet the task of unloading still continued by forklift that gave rise to risk whilst unloading.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

06-MAY-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before:	**Service method:**
09-MAY-2020	Delivered directly to the person named by electronic transmission
MELANIE KETCHEN Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2023557

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

Boggo Road Station Dutton park.
Temporary offices and lunch room facilities

I, John Azcune reasonably believe on 13-MAY-2020 at 09:48 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 22(2)(D), 33

Brief description of how the provision is being or has been contravened:

The PC has not ensure so far as reasonably practicable that the design of structure with the foreseeable works to be carried is designed in a way that reduces awkward work postures for workers.

During a work place visit with staff from CPB Contractors, Inspectors were shown a work area where work was and was about to recommence that was between office and lunch room modules that were stack to a three level formation.
Workers were to enter an area to connect power and other services. This work was over a 6 day period with workers taking breaks to relieve awkward posture. The work space was approximately 450mm to 350 mm in which worker were to crawl through and install wiring [pulling and pushing] and conduit.
I was told another structure on a different site was to be constructed in the similar format.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

14-MAY-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 03-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MICK NASH
Notice given to

Health And Safety Representative
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2023557

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2023765

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: THE RIX GROUP PTY LTD

ABN: 50092239113 | ACN:

Trading as:

Address: 21 ARGON ST, SUMNER 4074 QLD

Details of contravention:

Site location

867 MAIN ST, WOOLLOONGABBA 4102 QLD. TSW5N Station Box.

I, Geoffrey Collis reasonably believe on 14-MAY-2020 at 11:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

WORKERS WERE OBSERVED LOADING A STRAPPED BUNDLE OF 10 PIPE CASINGS ONTO A PAIR OF FABRICATED STEEL TRESTLES. THE TRESTLES WERE OBSERVED SET UP ON AN UNEVEN EARTH GROUND SURFACE. WORKERS COULD NOT PROVIDE DOCUMENTATION FOR THE WEIGHT OF THE PIPE OR THE SAFE WORKING LOAD TO BE APPLIED TO THE TRESTLES.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE SYSTEMS OF WORK;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice

Issuing Inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

14-MAY-2020 — Date issued

[redacted] — Inspector's location

This contravention must be remedied before: 20-MAY-2020

Service method: Delivered directly to the person named by electronic transmission

MARC LEVINSON — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name in block letters: MARC LEVINSON Position: PROJECT MANAGER

Signature: [redacted] Date complied: 18/05/2020

ABN 94 496 188 083


Notice No. I2023765

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

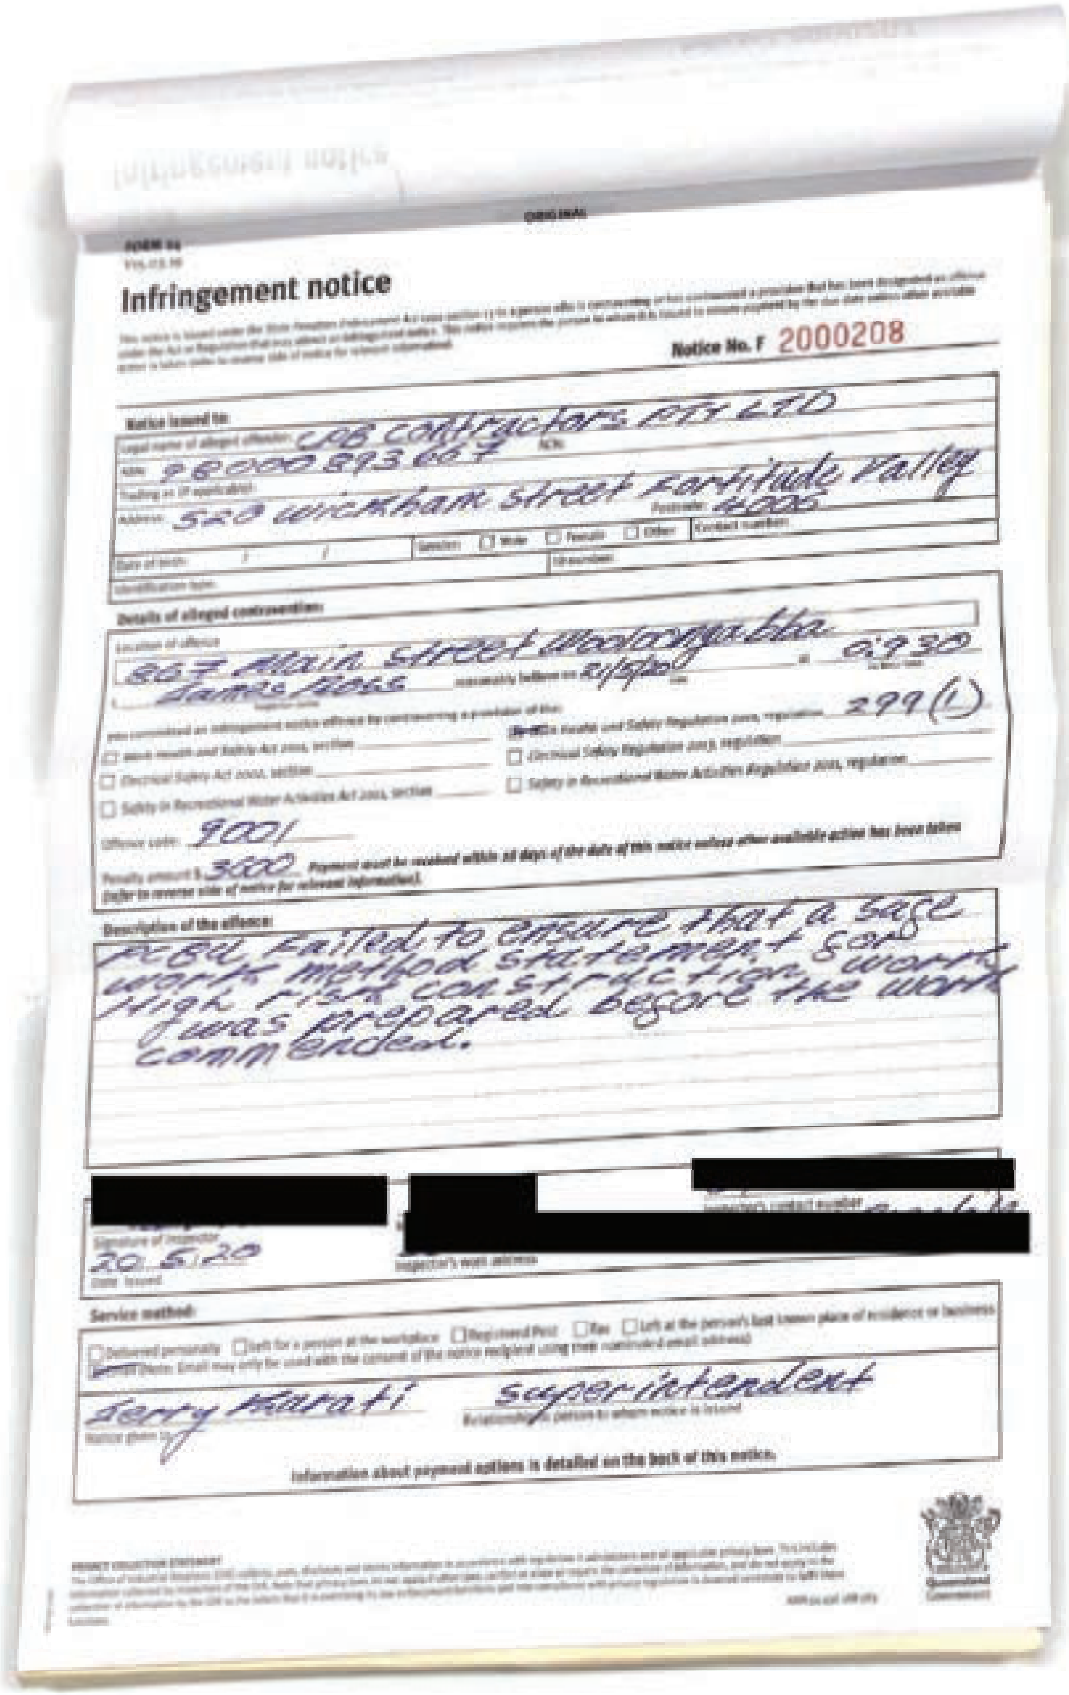

Infringement notice

Notice No. F 2000208

Notice issued to:

Legal name of alleged offender: CAB Contractors Pty Ltd

ABN: 98 000 893 667

Trading as (if applicable):

Address: 520 Wickham Street Fortitude Valley Postcode: 4006

Date of birth: / /

Gender: ☐ Male ☐ Female ☐ Other

Contact number:

Identification type:

ID number:

Details of alleged contravention:

Location of offence: 867 Main Street Mooroolbark at 0730 hrs

I, James Ross reasonably believe on 21/9/20 that

you committed an infringement notice offence by contravening a provision of the:

☐ Work Health and Safety Act 2011, section

☐ Electrical Safety Act 2002, section

☐ Safety in Recreational Water Activities Act 2011, section

☒ Work Health and Safety Regulation 2011, regulation 299(1)

☐ Electrical Safety Regulation 2013, regulation

☐ Safety in Recreational Water Activities Regulation 2011, regulation

Offence code: 9001

Penalty amount $ 3000 *Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).*

Description of the offence:

PCBU failed to ensure that a safe work method statement for high risk construction work was prepared before the work commenced.

[redacted] [redacted]

Signature of inspector

20/9/20

Date issued

Inspector's work address [redacted]

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business

☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Notice given to: Jerry Maraki

Relationship to person to whom notice is issued: Superintendent

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

Queensland Government

FORM 24
V15.05.19

ORIGINAL

Infringement notice

This notice is issued under the *State Penalties Enforcement Act* 1999 section 17 to a person who is contravening, or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000209

Notice issued to:

Legal name of alleged offender: Dandrum Civil Pty Ltd
ABN: 75 169 498 308 ACN:
Trading as (if applicable):
Address: 62 Fenaba Street, Richlands
Postcode: 4077
Date of birth: / / Gender: ☐ Male ☐ Female ☐ Other Contact number:
Identification type: ID number:

Details of alleged contravention:

Location of offence
33 Joe Baker Road Dutton Park
I James Ross (Inspector Name) reasonably believe on 20/5/20 (Date) at 13:00 (As 24 hour time)
you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☐ *Electrical Safety Act 2002*, section
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☑ *Work Health and Safety Regulation 2011*, regulation 300 (2)
- ☐ *Electrical Safety Regulation 2013*, regulation
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9003
Penalty amount $ 3600 **Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).**

Description of the offence:

PCBU Failed to ensure that high risk construction work not being carried out in accordance with the safe work method statement was stopped immediately, or as soon as it was safe to do so, and only resumed once the work was being done in accordance with the safe work method statement.

Issuing inspector:

[redacted]

Signature of inspector
20/5/20
Date issued

Inspector's ID [redacted]
Inspector's contact number

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☑ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

John Sutherland Safety Manager
Notice given to: Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 65 959 415 158

Queensland Government

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued.

If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this Infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, _____ _____
Given name/s Family name

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2003751

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

867 Main Street Wooloongabba

I, James Ross reasonably believe on 20-MAY-2020 at 09:30 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 299(1)

Brief description of how the provision is being or has been contravened:

Observed photographed noted a worker a drilling into concrete without any controls in place to manage workers being exposed to respirable crystaline silica.

A person conducting a business or undertaking that includes the carrying out of high risk construction work must, before high risk construction work commences , ensure that a safe work method statement for the propsed work is prepared.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

I [redacted]

Signature of inspector	Inspector's ID [redacted]	Inspector's contact number [redacted]
20-MAY-2020		
Date issued	Inspector's location [redacted]	

This contravention must be remedied before: 23-MAY-2020

Service method: Delivered directly to the person named by electronic transmission

JERRY KARATI — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2003751

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1023329

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of serious risk:

Site location — Direction given orally: Y

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Antony Lackey reasonably believe on 20-MAY-2020 at 08:15 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 32

I direct the person with control over the following activity to stop the activity of: Allowing workers on foot to enter the station box bulk excavation area with risks of being hit with mobile powered plant.

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

Failure to ensure so far as is reasonably practicable the provision and maintenance of safe systems of work. Two inspectors in the accompany of CPB representatives observed a worker on foot walk across the live hall road and into the station box area, a moxy bulk dump truck had entered the station box shortly after, this worker and another worker didn't have two on person, there was no delineated/ separation/ isolation controls implemented at the time. It was confirmed that the worker walking across the station box was going to use the amenities.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

20-MAY-2020 — Date issued

[redacted] — Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

JERRY KARATI — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

FORM 24
V15.03.19

ORIGINAL

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000418

Notice issued to:

Legal name of alleged offender: DUNDRUM CIVIL PTY LTD

ABN: 75 169 498 300 ACN:

Trading as (if applicable):

Address: 62 TERABA STREET, RICHLANDS, QLD

Postcode: 4077

Date of birth: / / Gender: ☐ Male ☐ Female ☐ Other Contact number:

Identification type: ID number:

Details of alleged contravention:

Location of offence

367 MAIN STREET, WOOLLOONGABBA, QLD 4102

I, ANTONY LACEY reasonably believe on 20-5-20 at 0815

you committed an infringement notice offence by contravening a provision of the:

☐ *Work Health and Safety Act 2011*, section ☑ *Work Health and Safety Regulation 2011*, regulation

☐ *Electrical Safety Act 2002*, section ☐ *Electrical Safety Regulation 2013*, regulation

☐ *Safety in Recreational Water Activities Act 2011*, section ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: WHL 9003 & P.T.Q.X

Penalty amount $ 3600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

FAILURE TO ENSURE THAT THE HIGH RISK ACTIVITY OF MOVEMENT OF MOBILE POWERED PLANT (EXCAVATOR OPERATIONS) WAS STOPPED IMMEDIATELY & RESUMED ONLY IN ACCORDANCE WITH THE WORK METHOD STATEMENT. I OBSERVED, NOTED & PHOTOGRAPHED A DUNDRUM EXCAVATOR OPERATING WITH THE DOOR OPEN UNTIL THE INSPECTOR INTERVENED. THE SAFE WORK METHOD STATEMENT PAGE 5 OF 11, EXCAVATOR OPERATIONS STATES "CABIN DOORS & WINDOWS MUST REMAIN CLOSED WHILST PLANT IS BEING OPERATED".

Issuing inspector:

[redacted] [redacted]

Signature of inspector Inspector's ID Inspector's contact number

21 / 5 / 20 [redacted]

Date issued

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☑ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

JOHN SUTHERLAND SAFETY MANAGER

Notice given to Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws confer or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 65 640 650 923

Queensland Government

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government

ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1020496

Notice issued to:

Legal name of person/business or undertaking: DELTA PTY. LTD.

ABN: 67007069794 | ACN: 007 069 794

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of serious risk:

Site location — Direction given orally: Y

Ground level coach deck near the bus stop/ 159 Roma Street Brisbane

I, James Ross reasonably believe on 22-MAY-2020 at 07:45 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(2), 32

I direct the person with control over the following activity to stop the activity of: The Excavator moving the concrete debris next to the public access way without appropriate controls to minimise the risks to members of the public health from respiriable crystaline silica.

until such time that controls are implemented to manage the risk of airborne respirable silica dust.

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

Observed photographed noted video a Excavator on a stockpile picking up parts of crushed concrete slab working in close proximity to a public footpath that members of the public, are using to access past the works being carried out. Observed noted there are no adequate controls in place to manage silica dust respirable crystalline silica. No water was observed to supress the silica dust. Observed a plume of concrete dust whilst the works was being carried out.
Delta Pty Ltd has failed to ensure so far as is reasonably practicable that the health and safety of others is not put at risk as a result of the works being carried out on site.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

22-MAY-2020 | [redacted]
Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

PAUL RYAN | Management Representative For Person Conducting A Business Or Undertaking
Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002613

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

I, Antony Lackey reasonably believe on 26-MAY-2020 at 11:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

Failure to ensure so far as is reasonably practicable the workplace is maintained so as to allow for persons to enter and exit and to move about with out risk to health and safety both under normal and emergency conditions. I observed, noted and photographed illuminated emergency exit signs at exit doors had restricted view/s, fire extinguisher not secured and missing identification and location signage, restricted view of first aide signage.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

26-MAY-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 29-MAY-2020

Service method: Delivered directly to the person named by electronic transmission

CHRIS TREVARROW

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002613

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Details of CFMEU Workplace Health and Safety Queensland Incidents

Date of Notice	06/04/2020
Notice Number	I2003753
Location	Roma St Station
Incident Description	Debris in Mobile Plant Area
Issued By	James Ross

FORM 24
V15.03.19

ORIGINAL

Infringement notice

This notice is issued under the *State Penalties Enforcement Act* 1999 section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000420

Notice issued to:

Legal name of alleged offender: IDEC SOLUTIONS PTY LTD	
ABN: 15 082 559 920	ACN:
Trading as (if applicable):	
Address: 265 QUEENSPORT ROAD NORTH, MURRARIE, QLD Postcode: 4172	
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other — Contact number:
Identification type:	ID number:

Details of alleged contravention:

Location of offence: 95 ALBERT STREET, BRISBANE, 4000 (ALBERT STREET STATION)

I, ANTONY LARKIN (inspector name) reasonably believe on 11-6-2020 (date) at 0810 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☑ *Work Health and Safety Regulation 2011*, regulation 300(2)
- ☐ *Electrical Safety Act 2002*, section
- ☑ *Electrical Safety Regulation 2013*, regulation
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9003 * P.T.O *

Penalty amount $ 3600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

FAILED TO ENSURE THE HIGH RISK CONSTRUCTION ACTIVITY (WORK AT HEIGHTS) IS CARRIED OUT IN ACCORDANCE WITH THE SAFE WORK METHOD STATEMENT. I OBSERVED NOTED & PHOTOGRAPHED IN THE PRESENCE OF CFB CONTRACTORS REPRESENTATIVES THAT ELECTRICAL WORKERS PERFORMING LIGHTING WORKS FOR IDEC SOLUTIONS PTY LTD DIDN'T HAVE AN "ESTABLISH DROP ZONE OR INSTALLED WARNING/ DANGER SIGNAGE" AS PER THE SAFE WORK METHOD STATEMENT. THE AC

Issuing inspector: [redacted]

Signature of inspector: [redacted] Inspector's ID: [redacted] Inspector's contact number: [redacted]

Date issued: 11 / 6 / 2020

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☑ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

DAMIEN CARTSHORE — Notice given to

MANAGING DIRECTOR — Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil these functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2004826

V1.3.16 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

lot 2, ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 15-JUN-2020 at 13:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33
Work Health and Safety Regulation 2011 - regulation 57(1)

Brief description of how the provision is being or has been contravened:

I have observed workers at the site where CPB Contractors Pty Limited have management or control of the construction work and I have identified that the workers are generally not using hearing protection where there is a noisy environment and I have directed 2 visitors to the workplace to use hearing protection where I believe the noise is likely to cause damage to a persons hearing

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person with management or control of the workplace has a duty to ensure so far as reasonably practicable that the risk of damage to a worker or visitors hearing is managed by enforcing the use of hearing protection at the workplace

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID [redacted] | Inspector's contact number

15-JUN-2020
Date issued

Inspector's location

This contravention must be remedied before: 18-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: MELANIE KETCHEN Position: SNR SAFETY ADVISOR - LEAD

Signature: [redacted] Date complied: 17/6/2020

ABN 94 496 188 983

Notice No. I2004826

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004827

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 148. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

lot 2, ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 15-JUN-2020 at 13:30 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 43(2)

Brief description of how the provision is being or has been contravened:

I have attended the site where CPB Contractors Pty Limited and observed the work area to identify that directional signage for an emergency is not in place for emergency access / egress, locations for first aid kits and other emergency equipment for example a stretcher for emergency retrieval of a worker to form a reasonable belief that the company has failed so far as reasonably practicable to maintain the emergency plan for the workplace

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person who has management or control of the workplace must ensure that emergency signage is maintained so that persons have directional signage in an emergency and have direction to the locations of emergency equipment that is part of emergency management planning at the workplace

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

15-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 19-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: MELANIE KETCHEN Position: SNR SAFETY ADVISOR - LEAD

Signature: [redacted] Date complied: 18/6/2020

ABN 94 496 188 983

Notice No. I2004827

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004828

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

LOT 2 ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 15-JUN-2020 at 13:17 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

i have observed and photographed a workplace workshop area on the way to a work area for the site water treatment plant where CBP Contractors Pty Limited have management or control and I have observed an inch or more of water in the work area, an electrical lead in water, steps made from formply for access to the water treatment plant area where work is being conducted and I have formed a reasonable belief that the person with management or control has failed to ensure so far as reasonably practicable that persons can enter and exit and move about the workplace without risk to health and safety

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person with management or control of a workplace must ensure so far as reasonably practicable that persons can enter and exit and move about the workplace without risk to health and safety

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

15-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 17-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS

Notice given to

Management Representative For Person With Management Or Control Of A Workplace

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004828

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2004829

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893567

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

LOT 2, ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Paul Watts reasonably believe on 15-JUN-2020 at 12:50 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 20(2), 33

Brief description of how the provision is being or has been contravened:

I have attended the workplace where CPB Contractors Pty Limited have management or control and I have identified a toilet designated for female use where there is no provision for disposal of sanitary items for females as specified in part 5A part 4 (2) (a) of the work health and safety regulations

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

a person with maangement or control of the workplace must ensure that provision for disposal of sanitary items for females as specified in part 5A part 4 (2) (a) of the work health and safety regulations is provided

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted]

Signature of Inspector | Inspector's ID | Inspector's contact number

15-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 18-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS

Notice given to

Management Representative For Person With Management Or Control Of A Workplace

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters:* MELANIE KEICHEN Position: SNR SAFETY ADVISOR - LEAD

Signature: [redacted] Date complied: 17/6/2020

ABN 94 496 188 983

Notice No. I2004829

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfill those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004721

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD	

Details of contravention:

Site location

159 Roma street, Brisbane CBD - 4000

I, Christopher O'Donnell reasonably believe on 15-JUN-2020 at 13:00 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 314

Brief description of how the provision is being or has been contravened:

The principal contractor for the project failed to put in place arrangements ensuring lighting allows for persons to move within the workplace without risk to health & safety & enables safe evacuation in an emergency.
I observed & photographed levels of the west tower used to access the active demolition site or to access the amenities provided. Natural light in lower levels was filtered by perimeter screening & other objects. This made several areas dark & difficult to see hazards in area¿s workers used for access/egress.
I observed several hazards in these areas including concrete debris, excess water, broken fluorescent lights & lengths of string/electrical wires. The hazards were not illuminated & some workers in the areas were wearing dark safety glasses effectively reducing the workers ability to see potential hazards. I was informed there had been no official assessment of the workplace to ensure there is enough light to ensure safe access to & from the workplace.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]
Signature of inspector

[redacted]
Inspector's ID

[redacted]
Inspector's contact number

15-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before:	Service method:
19-JUN-2020	Delivered directly to the person named by electronic transmission
FARREN WYPER Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2004721

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters:* PETER EVERILL Position: SAFETY MANAGER

Signature: [redacted] Date complied: 18/06/2020

ABN 94 496 188 983

Notice No. I2004721

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004830

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: LCR GROUP PTY LTD

ABN: 78095626798 | ACN:

Trading as:

Address: 30 TILE ST, WACOL 4076 QLD

Details of contravention:

Site location

Lot 2 of Albert Street Station Construction site, Brisbane 4000

I, Paul Watts reasonably believe on 16-JUN-2020 at 08:30 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 235(2)

Brief description of how the provision is being or has been contravened:

I have attended worksite where LCR Group Pty Ltd have a 100t mobile crane registeration number POO36606 in use for construction work and I have made enquiries to identify that the crane has not had a 10 yearly inspection as specified in work health and safety regulations

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

LCR Group Pty Ltd must ensure that registerable plant (Mobile Cranes) are subject to 10 yearly inspections as specified by work health and safety regulations

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

16-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 30-SEP-2020

Service method: Delivered directly to the person named by electronic transmission

TRENT BEARD

Notice given to

Relationship to person to whom notice is issued: Management Representative For Person Conducting A Business Or Undertaking

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004830

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2021556

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

LOT 2, ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Steve Rushton reasonably believe on 16-JUN-2020 at 11:45 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 43(2)

Brief description of how the provision is being or has been contravened:

The PCBU, namely CPB Contractors Pty Ltd has failed to ensure so far as is reasonably practicable, that the emergency plan has been maintained so that it remains effective.
Observations, photographs, notebook notes, and conversations with relevant persons identified that as work has progressed effective emergency plans have not been maintained for the activities of accessing / egressing and working in the Tunnel Shaft.
The documented emergency plan does not detail the rescue / retrieval procedure.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 43(2)
A PERSON CONDUCTING A BUSINESS OR UNDERTAKING AT A WORKPLACE MUST MAINTAIN THE EMERGENCY PLAN FOR THE WORKPLACE SO THAT IT REMAINS EFFECTIVE.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

16-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 20-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2021556

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12
V1.1.12

RECIPIENT'S COPY

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice No. P1026098

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of serious risk:

Site location | Direction given orally: Y

LOT 2, ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Steve Rushton reasonably believe on 16-JUN-2020 at 11:45 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

I direct the person with control over the following activity to stop the activity of: Accessing the Tunnel Shaft,

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

The PCBU, namely CPB Contractors Pty Limited has failed to ensure so far as is reasonably practicable, that the layout of the workplace allows, and that the workplace is maintained so as to allow, persons to enter, exit and move about without risk to health and safety, both under normal working conditions and in an emergency.
Observations, photographs, notebook notes, measurements taken and conversations with relevant persons identified these issues but not limited to: The erected CALBAH Stretcher stairs to the Tunnel shaft is the primary means of access and egress. The risers on the stair access to the landing are inconsistent, there is difference of approx. 50mm.betwen risers. The handrail from the top landing going down the stairs is approx. 840mm.
A crane is positioned, and the first aid cage are designated to be used as the secondary means of recovery in the event of an emergency.
(continue in directions section)

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

There is no clear access to the first aid cage. Plant and other items are blocking access for riggers / doggers to dog the load. Gantry erected yesterday above the first aid cage, which now restricts the crane movement from lifting the first aid cage. The documented emergency plan does not detail the rescue / retrieval procedure.

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

16-JUN-2020
Date issued

[redacted]
Inspector's location

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.worksafe.qld.gov.au/.

Service method:

Delivered directly to the person named by electronic transmission	
JOSHUA SIMS	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002750

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DELTA PTY. LTD.

ABN: 67007069794 | ACN: 007 069 794

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

West Tower Roma Street Station

I, Lewis Cash reasonably believe on 15-JUN-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(1), 33
Work Health and Safety Regulation 2011 - regulation 54

Brief description of how the provision is being or has been contravened:

I observed large concrete rubble and smashed glass wedged between the scaffold and the structure under demolition. There is evidence on the lower levels that this debris has fallen and smashed through the side windows in an area workers use as access. There are insufficient controls in place to ensure workers are not put at risk from falling objects.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

16-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 18-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PAUL RYAN — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2002750

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2004001

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DELTA PTY. LTD.

ABN: 67007069794 | ACN: 007 069 794

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

West Tower Roma Street Station

I, Lewis Cash reasonably believe on 15-JUN-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

I observed during an inspection that the site is not maintained to allow for workers to enter and exit areas safely as there is no clear accessways or delineated pathways through the site. There was large quantities of water puddling in accessways with no process in place for dewatering which gives rise to the risk of slips trip and falls for the workers accessing the demolition area.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

16-JUN-2020 — Date issued

[redacted] — Inspector's location

This contravention must be remedied before:	Service method:
19-JUN-2020	Delivered directly to the person named by electronic transmission
PAUL RYAN (Notice given to)	Management Representative For Person Conducting A Business Or Undertaking (Relationship to person to whom notice is issued)

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: PAUL RYAN Position: PROJECT MANAGER

Signatur[redacted] Date complied: 16/6/20.

ABN 94 496 188 983

Notice No. I2004001

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Reference: Improvement Notice No: I20024001 **Western Tower Building**

ISSUE: I observed during an inspection that the site is not maintained to allow for workers to enter and exit areas safely as there is no clear accessways or delineated pathways through the site. There was large quantities of water puddling in accessways with no process in place for dewatering which gives rise to the risk of slips trip and falls for the workers accessing the demolition area.

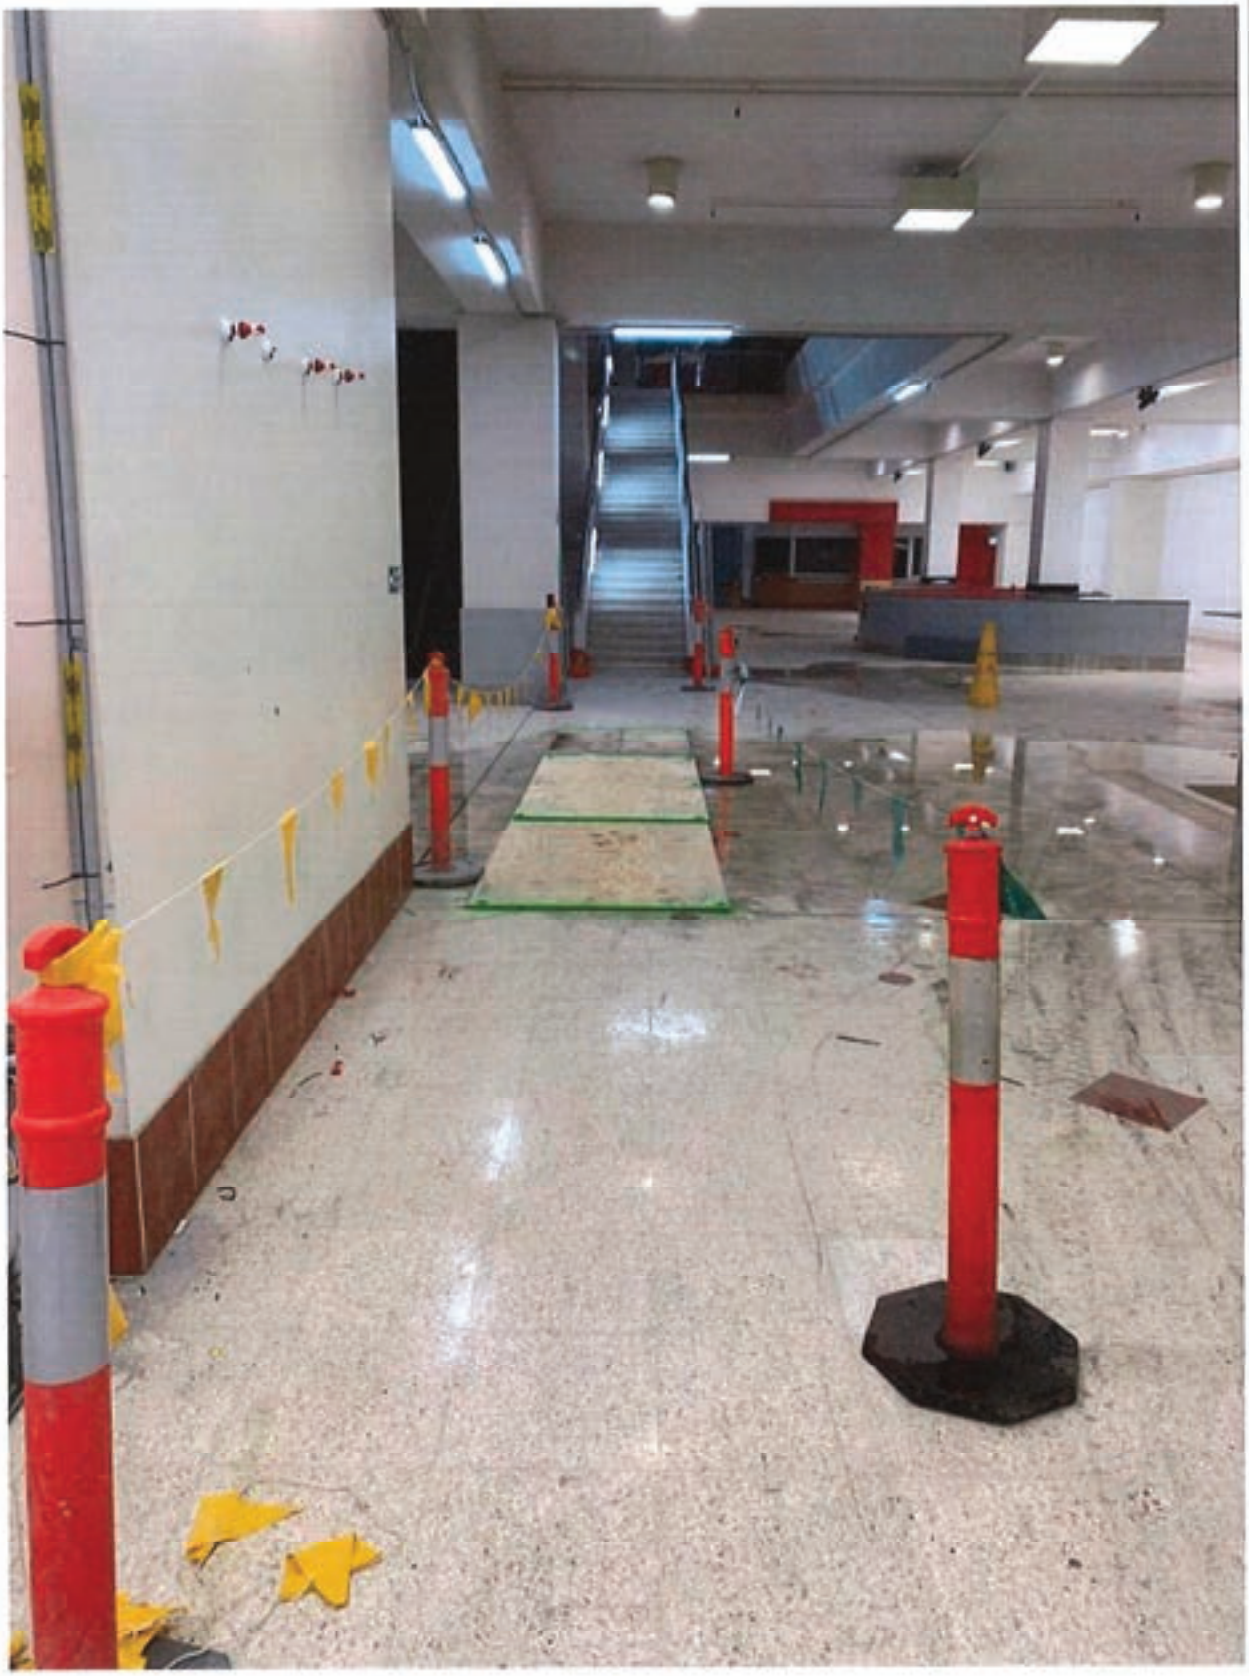


Figure 1 - Shows Level 3 Eastern Tower (Food Court Area)

ACTION COMPLETED

Access Ways cleaned of water / Clearly demarcated from wet areas, and ply placed above.

Water diversions being created where there is potential for escape to walkways.

Temporary lights installed.



Figure 2 - Shows Level 3 Eastern Tower (Food Court Area)



Figure 3 - Floor 7 - Holes created in ground to get water off access ways to restricted Level 6 (closed off for access, with no personnel access & demo activity occurring)



Figure 4 – Level 7 - Additional Temporary lighting installed on walkways

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024101

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

WOOLLOONGABBA STATION, CORNER JURGENS STREET AND LOGAN RD, WOOLLOONGABBA 4102 QLD

I, Paul Kitchener reasonably believe on 16-JUN-2020 at 14:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

I observed and photographed a generator at the workplace which had not had daily checks performed on the unit in accordance with manufacturer's instructions. The generator was in use and had not had a pre start check that day. The last pre start check was listed on 27th May 2020. I observed another generator which had only had a pre start check completed today after being brought to the attention of the PCBU by an external stakeholder group.
You have not ensured so far as reasonably practicable the maintenance of safe plant at the workplace.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Act 2011 - section 19(3)(B)
WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE PLANT AND STRUCTURES

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

16-JUN-2020 | PO BOX 829, WOODRIDGE 4114 QLD

Date issued | Inspector's location

This contravention must be remedied before: 20-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JERRY KARATI — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in blo* [redacted] KARATI Position: Senior Safety Advisor.

Signature: [redacted] Date complied: 16/6/2020.

ABN 94 496 188 963

Notice No. I2024101

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Improvement notice

Notice No. I2024101

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2021557

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Steve Rushton reasonably believe on 16-JUN-2020 at 12:15 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

The PCBU, namely CPB Contractors Pty Ltd has failed to ensure so far as is reasonably practicable, that the system of managing lifting gear is maintained to record all plant.
Walk around site, observations, photographs taken and discussions on various items of plant that had not been recorded on the lifting register.
As PC review and amend measures that are in place to effectively maintain the lifting registers.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Refer to Mobile Crane Code of Practice 2006 section stated but not limited to: 13.1.2, 13.2.1

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

17-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 20-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

JOSHUA SIMS
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2021557

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I1024368

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

ALBERT STREET STATION LOT 2

I, Peter Stevens reasonably believe on 17-JUN-2020 at 11:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 20(2), 33

Brief description of how the provision is being or has been contravened:

Inspection of the CPB Albert Street Station Lot 2 site, water treatment plant work area, identified that only one means of access is currently accessible. The current means of access is also somewhat restricted due to installed scaffold and also a concrete upstand approximately 500mm high exists within the doorway. Should an emergency situation occur, persons may not be able to quickly and safely exit the area which has the potential to place persons at risk of injury in emergency situations. The current access to the area is also insufficient for normal work situations.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

AS THE PERSON WITH MANAGEMENT OR CONTROL OF A WORKPLACE, YOU MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THAT THE WORKPLACE, THE MEANS OF ENTERING AND EXITING THE WORKPLACE AND ANYTHING ARISING FROM THE WORKPLACE ARE WITHOUT RISKS TO THE HEALTH AND SAFETY OF ANY PERSON.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

17-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 20-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

MELANIE KETCHEN

Notice given to

Management Representative For Person With Management Or Control Of A Workplace

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I1024368

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1025031

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD	

Details of serious risk:

Site location — Direction given orally: Y

Water Treatment Plant, Albert St Cross River Rail Station

I, Paul Kitchener reasonably believe on 17-JUN-2020 at 11:45 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 225(4)

I direct the person with control over the following activity to stop the activity of: Use of Scaffold

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I observed and photographed a small lightweight scaffold which was erected in an access way near the water treatment plant. The scaffold was in excess of five metres high, and had access ladders to platforms which allowed workers to access from level to level. The ladders to each level required a person to step backwards and to the LHS to access each platform. There was no hand rail system on each platform, which would allow a person to fall from one level to another, or fall the entire distance of the scaffold. There was a single tie to the structure of a water tank. The scaffold diagrams showed the tie located correctly, but did not show any requirement for handrails. The first platform level was in excess of two metres. The above circumstances create a risk to the health and safety of persons at the workplace.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 225(4)
IF AN INSPECTION INDICATES THAT A SCAFFOLD AT A WORKPLACE OR ITS SUPPORTING STRUCTURE CREATES A RISK TO HEALTH OR SAFETY, THE PERSON WITH MANAGEMENT OR CONTROL OF THE SCAFFOLD MUST ENSURE THAT- (A) ANY NECESSARY REPAIRS, ALTERATIONS AND ADDITIONS ARE MADE OR CARRIED OUT; AND (B) THE SCAFFOLD AND ITS SUPPORTING STRUCTURE ARE INSPECTED AGAIN BY A COMPETENT PERSON BEFORE USE OF THE SCAFFOLD IS RESUMED.

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted]

Signature of inspector	Inspector's ID	Inspector's contact number
17-JUN-2020	[redacted]	
Date issued	Inspector's location	

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Service method:

Delivered directly to the person named by electronic transmission	
MELANIE KETCHEN	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice Issued to: **Notice No. F** 2006164

Legal name of alleged offender: CPB Contractors Pty Ltd

ABN: 98 000 893 667 ACN:

Trading as (if applicable): CBCU D+C JV

Address: Level 3, 339 Coronation Drive, Milton

Date of birth: / / Gender: ☐ Male ☐ Female ☐ Other Postcode: 4064

Identification type: ID number: Contact number:

Details of alleged contravention:

Location of offence

Woolloongabba Station CNR Jurgens St + Logan Rd Woolloongabba

I, Paul Robert Kitchener (Inspector name) reasonably believe on 16 June 2020 (Date) at 1400 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

☐ *Work Health and Safety Act 2011*, section

☐ *Electrical Safety Act 2002*, section

☐ *Safety in Recreational Water Activities Act 2011*, section

☑ *Work Health and Safety Regulation 2011*, regulation 346(1)(b)

☐ *Electrical Safety Regulation 2013*, regulation

☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9012 9011

Penalty amount $3000.00 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

PCBU failed to ensure that the hazardous chemical register is maintained so that the information in the register is up to date

[redacted]

Signature of inspector [redacted] Inspector's ID [redacted] Inspector's contact number

17/6/2020 Date issued

Inspector's work address

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☒ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business

☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Brogue Rinebarger Notice given to

PCBU Representative Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 94 495 188 983

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2004723

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: KENNY CONSTRUCTION PTY LTD	
ABN: 31065215429	ACN:
Trading as:	
Address: JOE BAKER STREET , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

Joe Baker St, Dutton Park, Queensland 4102

I, Christopher O'Donnell reasonably believe on 17-JUN-2020 at 13:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(1), 33

Brief description of how the provision is being or has been contravened:

The PCBU, namely Kenny Construction Pty Ltd has failed to ensure so far as is reasonably practicable, the health and safety of workers engaged, engaged or caused to be engaged by the person while the workers are at work in the business or undertaking.
I observed and photographed a can of WCC Liquid Zinc Aerosol in a storage container used by the PCBU. The can was full at the time of inspection and has been classified as a Hazardous Chemical and a Dangerous Good according to the WHS Regulations and the ADG Code. The person failed to ensure that sufficient information about the safe use, handling and storage of the hazardous chemical was readily accessible to workers at the workplace; and an emergency service worker, or anyone else, who is likely to be exposed to the hazardous chemical at the workplace.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice

Issuing inspector:

[redacted]

Signature of inspector	Inspector's ID	Inspector's contact number
18-JUN-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	Service method:
24-JUN-2020	Delivered directly to the person named by electronic transmission
STEPHEN BRENNAN	Management Representative For Person With Management Or Control Of A Workplace
Notice given to	Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004723

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004002

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

I, Lewis Cash reasonably believe on 17-JUN-2020 at 13:30 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation SCHEDULE5A,PART2,2(1)

Brief description of how the provision is being or has been contravened:

The Principal Contractor has failed to ensure that toilets are reasonably available to each person on the construction site. During an inspection it was identified that workers had to walk an unreasonable distance up sloping terrain and stairs from a work area at the deepest part of the excavation to access toilets. There were no female/ unisex toilets provided within a reasonable distance from the work area, female workers have to cross live traffic in order to access toilet amenities.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

18-JUN-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 20-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004722

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

I, Christopher O'Donnell reasonably believe on 17-JUN-2020 at 11:00 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

The PCBU, namely CPB Contractors P/L (CPB) failed to ensure so far as is reasonably practicable the provision and maintenance of a safe system of work for all workers.
I observed and photographed workers engaged by CPB carrying out construction work in an area at the workplace in which there is movement of powered mobile plant (plant) namely a telehandler
I consulted with the Safety Advisor for the site and a member of the workforce observed working near plant. The information obtained during the consultation identified only the operators of the plant and workers directly involved in the task are trained in the SWMS. Workers carrying out construction work in an area at a workplace in which there is any movement of plant in high risk construction work giving rise the risk of serious injury or death if a worker was to be struck by plant.
CPB must ensure the provision and maintenance of safe systems of work for all workers.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]		
Signature of inspector	Inspector's ID [redacted]	Inspector's contact number [redacted]
18-JUN-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	**Service method:**
24-JUN-2020	Delivered directly to the person named by electronic transmission
PETER CULLEN	Management Representative For Person With Management Or Control Of A Workplace
Notice given to	Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004722

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004722

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2023875

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

Rear of office demountables

I, Gary Matheson reasonably believe on 18-JUN-2020 at 16:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 315E(2)(A)

Brief description of how the provision is being or has been contravened:

I observed and photographs taken of fence at rear of multi storied demountables which was not 1800mm high and did not have a solid hoarding and there is a risk of falling objects hitting members of the public in an adjacent area

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

18-JUN-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 25-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters*: PETER CULLEN Position: SAFETY ADVISOR

Signature: [redacted] Date complied: 24/06/2020

ABN 94 496 188 983

Notice No. I2023875

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2023876

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

Stairs and platforms on multi-storeyed demountables

I, Gary Matheson reasonably believe on 18-JUN-2020 at 16:14 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 315E(2)(B)

Brief description of how the provision is being or has been contravened:

I observed and photographed the stairs and walkways did not have any controls in place to prevent objects from falling and there was a risk of injury on persons from the levels of the demountable multi-storeyed structure

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

18-JUN-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 25-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters*: PETER CULLEN Position: SAFETY ADVISOR

Signature [redacted] Date complied: 24/06/2020

ABN 94 496 188 953

Notice No. I2023876

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government

ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1031392

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of serious risk:

Site location — Direction given orally: Y

crib hut ground floor

I, Jason Plath reasonably believe on 18-JUN-2020 at 11:23 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(1), 32

I direct the person with control over the following activity to stop the activity of: Accessing crib hut

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I observed and photographed white plastic chairs designed for domestic use only and only ratted for 100kg being used in crib hut for workers to sit on. Warning on back of chair states do not use the chair on slippery or shiny surfaces, crib hut floor is vinyl. Workers exceeding 100kg are exposed to the risk of serious injury if chair designed for domestic use only fails. PC must ensure that items used/supplied are fit for use.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

18-JUN-2020 | [redacted]
Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

PETER CULLEN | Management Representative For Person Conducting A Business Or Undertaking
Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1031393

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of serious risk:

Site location — Direction given orally: Y

Top office

I, Jason Plath reasonably believe on 18-JUN-2020 at 10:30 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

I direct the person with control over the following activity to stop the activity of: Accessing top office

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

Discussion had with Electrical Trade Union and test done on emergency lighting has revealed that the lighting within the building was not fully operational. In an emergency evacuation workers would not have adequate lighting to exit safely.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

18-JUN-2020 | [redacted]
Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

PETER CULLEN | Management Representative For Person Conducting A Business Or Undertaking
Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1031394

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of serious risk:

Site location — Direction given orally: Y

ground floor crib hut

I, Jason Plath reasonably believe on 18-JUN-2020 at 11:50 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

I direct the person with control over the following activity to stop the activity of: accessing crib hut

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I observed no emergency evacuation lighting in crib hut to allow workers to exit the building safely in an emergency.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

18-JUN-2020 | [redacted]
Date issued | Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

PETER CULLEN | Management Representative For Person Conducting A Business Or Undertaking
Notice given to | Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2002620

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Antony Lackey reasonably believe on 19-JUN-2020 at 08:00 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

Failure to ensure so far as reasonably practicable the provision and maintenance of safe systems of work. I observed, noted and photographed at the time of site visit no hand over certification was available by a competent person for the 5m access gantry, the inspection test plan had a hold point signed that this certification had been received, no certification could be produced for the hold point date of 20/3/2020 in the inspection test plan for the procedure of temporary works.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

19-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 26-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

MARK TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 963

Notice No. I2002620

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 24
V15.03.19

RECIPIENT'S COPY

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2006165

Notice issued to:

Legal name of alleged offender: CPB Contractors Pty Ltd		
ABN: 98 000 893 667	ACN:	
Trading as (if applicable):		
Address: Level 3, 339 Coronation Drive, Milton		
Postcode: 4064		
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other	Contact number:
Identification type:	ID number:	

Details of alleged contravention:

Location of offence

Woolloongabba Station, CNR Jurgens Rd + Logan Rd Woolloongabba

I, Paul Robert Kitchener (Inspector name) reasonably believe on 18 June 2020 (date) at 1142 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section _____
- ☑ *Work Health and Safety Regulation 2011*, regulation 346(1)(b)
- ☐ *Electrical Safety Act 2002*, section _____
- ☐ *Electrical Safety Regulation 2013*, regulation _____
- ☐ *Safety in Recreational Water Activities Act 2011*, section _____
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation _____

Offence code: 9011

Penalty amount $ 3600.00 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

PCBU failed to ensure that the hazardous chemical register is maintained so that the information in the register is up to date

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

19/6/2020 Date issued

Inspector's work address

Service method:

☑ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Jerry Karati — Notice given to

Representative of PCBU — Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

AEU19/5166

ABN 94 496 188 983

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024102

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

Southern end of haul road near entry gate
Woolloongabba Station Cnr Jurgen St & Logan Rd

I, Paul Kitchener reasonably believe on 18-JUN-2020 at 11:00 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

I observed and photographed vehicular traffic (trucks etc) traversing a haul road at the workplace. There was a site office for Geotech workers and two half containers opening directly onto the carriageway. I observed workers accessing the site office. There was a small truck partially blocking the carriageway while being unloaded, causing a narrow carriageway for larger trucks. There was no delineated walkway providing protection for workers accessing the site office or containers. There was no designated area for unloading of trucks.
On 19/6/2020 I observed and photographed barriers in front of office, partially addressing issue. The other areas of concern remain the same.
You have not, so far as reasonably practicable, ensured the layout of the workplace is maintained to allow for persons to exit and enter without risk to health and safety.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 40(A)
A PERSON CONDUCTING A BUSINESS OR UNDERTAKING AT A WORKPLACE MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THE FOLLOWING- (A) THE LAYOUT OF THE WORKPLACE ALLOWS, AND THE WORKPLACE IS MAINTAINED SO AS TO ALLOW, FOR PERSONS TO ENTER AND EXIT AND TO MOVE ABOUT WITHOUT RISK TO HEALTH AND SAFETY, BOTH UNDER NORMAL WORKING CONDITIONS AND IN AN EMERGENCY

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

19-JUN-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before:	**Service method:**
24-JUN-2020	Delivered directly to the person named by electronic transmission
JERRY KARATI Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2024102

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: JERRY KAPATI Position: Senior Safety Advisor.

Signat[redacted] Date complied: 20/06/20.

ABN 94 49[redacted]

Notice No. I2024102

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13

RECIPIENT'S COPY

Improvement notice

V1.3.18

Notice No. I1024360

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CAPORN FOUNDATIONS PTY LTD

ABN: 12130900604 | ACN: 130900604

Trading as:

Address: 139-169 POTASSIUM ST , NARANGBA 4504 QLD

Details of contravention:

Site location

BOGGO ROAD STATION, BOGGO RD, DUTTON PARK

I, Peter Stevens reasonably believe on 22-JUN-2020 at 11:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

Inspection of the Caporn Piling work area at the CPB Contractors Boggo Rd Station site identified that material boxes such as the tremelo rack and wash down unit are not included on the lifting gear register. Inspection timeframes and records of the equipment are therefore unable to be easily verified on site.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

AS A PERSON CONDUCTING A BUSINESS OR UNDERTAKING,YOU MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE SYSTEMS OF WORK IN RELATION TO LIFTING EQUIPMENT

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | Inspector's contact number

Signature of inspector | Inspector's ID

22-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 04-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MAL ROCHESTER

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters*: R.M. ROCHESTER Position: HSEQ Manager

Signature: [redacted] Date complied: 3/07/20

ABN 94 496 188

Notice No. I1024360

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

V1.3.18

Notice No. I1024361

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CAPORN FOUNDATIONS PTY LTD

ABN: 12130900604 | ACN: 130900604

Trading as:

Address: 139-169 POTASSIUM ST , NARANGBA 4504 QLD

Details of contravention:

Site location

BOGGO ROAD STATION, BOGGO RD, DUTTON PARK

I, Peter Stevens reasonably believe on 22-JUN-2020 at 11:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(D), 33

Brief description of how the provision is being or has been contravened:

Inspection of the Caporn Piling work area at the CPB Contractors Boggo Rd Station site identified that material boxes such as the tremelo rack and wash down unit are not marked with a tare mass or SWL. The lifting boxes were also not individually uniquely identifiable and no records of maintenance or inspections were available for inspection at the time.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

AS A PERSON CONDUCTING A BUSINESS OR UNDERTAKING, YOU MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE SAFE USE, HANDLING AND STORAGE OF PLANT, STRUCTURES AND SUBSTANCES;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Refer to the Mobile Crane Code of Practice 2006 section 13.2.1, 13.2.3 Material Boxes for specific information

Issuing inspector:

[redacted] | [redacted] | Inspector's contact number

Signature of inspector | Inspector's ID

22-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 04-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MAL ROCHESTER — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters*: R.M. ROCHESTER Position: HSEQ Manager

Signature: [redacted] Date complied: 03/07/20

ABN 94 496 188 963

Notice No. I1024361

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I1024366

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

I, Peter Stevens reasonably believe on 22-JUN-2020 at 13:15 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(D), 33

Brief description of how the provision is being or has been contravened:

Inspection of the office complex at the CPB CONTRACTORS PTY Limited BOGGO ROAD STATION site identified that the installed steel handrail system on the stairs and platforms have had scaffold tubes with presribed lining attached for falling objects protection 1.8 metres high. Advice from the handrail designer was available to indicate the installation of 1.5metre high solid lining would not be likely to overload the wind rating design capabilities of the handrail system. Information was not available on site to verify that the installed 1.8 meter high scaffold tube and prescribed lining will not overload the wind load design capability of the handrail system.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

AS A PERSON CONDUCTING A BUSINESS OR UNDERTAKING, YOU MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE SAFE USE, HANDLING AND STORAGE OF PLANT, STRUCTURES AND SUBSTANCES;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] |

Signature of inspector | Inspector's ID | Inspector's contact number

22-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 27-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I1024366

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024738

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

Boggo Road, Dutton Park

I, Daniel Ala-Outinen reasonably believe on 22-JUN-2020 at 12:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(D), 33
Work Health and Safety Regulation 2011 - regulation 351(1)

Brief description of how the provision is being or has been contravened:

The PCBU has failed to manage the risks associated with the storage, use and handling of hazardous chemicals. The work processes on site regarding the management and storage of hazardous chemical pallet containers (Pallecons) are not followed as per SDS. It was observed and photographed that a Pallecon containing Aluminium Sulphide that was awaiting removal from site had approx. 100mm of fluid left at the bottom of the container and was sitting out in the open. The SDS and the label on the front of the Pallecon stated that it must be stored under cover.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | Inspector's contact number

22-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before:	**Service method:**
27-JUN-2020	Delivered directly to the person named by electronic transmission
PETER CULLEN Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2024738

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I1024359

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: SIDE BY SIDE SCAFFOLDING AND RIGGING SERVICES (AUS) PTY LTD	
ABN: 33169610253	ACN: 169610253
Trading as:	
Address: 484B BILSEN RD, GEEBUNG 4034 QLD	

Details of contravention:

Site location

WOOLOONGABBA STATION CROSS RIVER RAIL, MAIN ST, WOOLLOONGABBA

I, Peter Stevens reasonably believe on 23-JUN-2020 at 11:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

Inspection of the scaffold erected at the stage 2 facilities building on the CPB Contractors Pty Ltd Woolloongabba Cross River Rail site identified that the scaffold was non compliant at the time of inspection. Stairs had no handrail and base plates were not appropriately supported and were bearing on the edge of the baseplates due to sole boards being on an incline.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

AS A PERSON CONDUCTING A BUSINESS OR UNDERTAKING, YOU MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE PLANT AND STRUCTURES;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Inspector's contact number

23-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 26-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

MIKE TEHIKO
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I1024359

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2000156

Notice issued to:

Legal name of alleged offender: CPB CONTRACTORS PTY LIMITED			
ABN: 98000893667	ACN: 000893667		
Trading as (if applicable): CBGU QRC JV			
Address: Albert Street Station, Albert St, Brisbane Postcode: 4000			
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other	Contact number:	
Identification type:	ID number:		

Details of alleged contravention:

Location of offence: LOT 2 Albert Street Station, Albert St, Brisbane 4000 QLD

I, Lewis Cash (Inspector name) reasonably believe on 22/06/20 (date) at 1400 (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☒ *Work Health and Safety Regulation 2011*, regulation 346(1)
- ☐ *Electrical Safety Act 2002*, section
- ☐ *Electrical Safety Regulation 2013*, regulation
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9011

Penalty amount $ 3600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

PCBU failed to ensure that a register of hazardous chemicals used, handled or stored at the workplace is prepared and kept at the workplace, and the register is maintained to ensure the information in the register is up to date.

Issuing inspector:

[redacted] (Signature of inspector) [redacted] (Inspector's ID) [redacted] (Inspector's contact number)

23/06/20 (Date issued) Brendale (Inspector's work address)

Service method:

☐ Delivered personally ☐ Left for a person at the workplace ☒ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☒ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Melanie Ketchen (Notice given to) PC representative (Relationship to person to whom notice is issued)

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 65 439 159 923

Queensland Government

What to do next

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued.

If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this Infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, _____ _____

Given name/s Family name

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013511

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

I, Travis Dungey reasonably believe on 23-JUN-2020 at 11:40 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(1), 33
Work Health and Safety Regulation 2011 - regulation 351(1)

Brief description of how the provision is being or has been contravened:

While on site checking the hazard chemical sheds, corrosive chemicals were identified. Safety Data Sheet for those products indicated that if it comes in contact with a persons skin immediately wash with water and soap. Conversations with relevant persons indicated that no washing station was available in the Immediate area. This is putting workers at risk when using, handling, generating or storing a Hazardous Chemical.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST MANAGE, UNDER PART 3.1, RISKS TO HEALTH AND SAFETY ASSOCIATED WITH USING, HANDLING, GENERATING OR STORING A HAZARDOUS CHEMICAL AT A WORKPLACE.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]	[redacted]	[redacted]
Signature of inspector	Inspector's ID	Inspector's contact number
23-JUN-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	**Service method:**
27-JUN-2020	Delivered directly to the person named by electronic transmission
PETER CULLEN	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013511

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024106

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

Station Box Southern End, Boggo Road Station.

I, Paul Kitchener reasonably believe on 23-JUN-2020 at 11:30 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 41(1)

Brief description of how the provision is being or has been contravened:

I observed and photographed a work area (Station Box Southern End) where workers would be expected to walk in excess of 80 metres to access drinking water and toilet facilities. A water facility was provided adjacent to the station box while I was onsite; a sit toilet was unable to be provided and had not been provided by the time I left site at 1225. You have failed to ensure so far as reasonably practicable ensured the provision of adequate facilities for workers.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 41(1)
A PERSON CONDUCTING A BUSINESS OR UNDERTAKING AT A WORKPLACE MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE, THE PROVISION OF ADEQUATE FACILITIES FOR WORKERS, INCLUDING TOILETS, DRINKING WATER, WASHING FACILITIES AND EATING FACILITIES.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

23-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 26-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block le*[redacted] BROGNE RINEBARGER Position: TUNNEL SAFETY MANAGER

Signature: [redacted] Date complied: 23/6/20

ABN 94 496 188 [redacted]

Notice No. I2024106

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2024739

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: THE RIX GROUP PTY LTD

ABN: 50092239113 | ACN:

Trading as: THE RIX GROUP PTY LTD

Address: 21 ARGON ST, SUMNER 4074 QLD

Details of contravention:

Site location

Cross River Rail Project, Woolloongabba

I, Daniel Ala-Outinen reasonably believe on 23-JUN-2020 at 10:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(D), 33

Work Health and Safety Regulation 2011 - regulation 351(1)

Brief description of how the provision is being or has been contravened:

The PCBU has failed to manage the risks associated with the storage, use and handling of hazardous chemicals. The work processes on site regarding the management and storage of hazardous chemical containers are not followed as per SDS. It was observed and photographed that there were various hazardous chemicals sitting in a chemical storage area in direct sunlight. These chemicals included: red and yellow Jerry can style containers both metal and plastic containing Petrol and Diesel and Various size buckets containing corrosive liquids. The SDS for the chemicals stated that they must not be stored in direct sunlight.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice

Issuing inspector:

[redacted] | [redacted] | Signature of inspector | Inspector's ID | Inspector's contact number

23-JUN-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 27-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

MARK LEVINSON

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block le*[redacted] KARAN BHUDIA (ON BEHALF OF MARC LEVINSON) Position: PROJECT ENGINEER

Signature [redacted] Date complied: 26/06/2020.

ABN 94 496 18[redacted]

Notice No. I2024739

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2005124

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: FORMCON PTY LTD

ABN: 42166785968 | ACN:

Trading as:

Address: 67 ENKLEMAN DR, YATALA 4207 QLD

Details of contravention:

Site location

ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Lee Franklin reasonably believe on 26-JUN-2020 at 09:10 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 39(3)

Brief description of how the provision is being or has been contravened:

I observed and photographed a LCR dogman under the instruction of Formcon representative lay down 2 packs of reo linkage in an area where there was inadequate access and egress to the lay down area. Through conversation with PC representative, the relevant PCBU representative and a worker I formed the belief that lay down area inspection and instruction given to the dogman with regard to the accessing the lay down area were not clear nor understood giving rise to risk of injury to worker.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | Inspector's ID | Inspector's contact number

Signature of inspector

26-JUN-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 30-JUN-2020

Service method: Delivered directly to the person named by electronic transmission

DANIEL NAGLE
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2005124

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013710

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DELTA PTY. LTD.

ABN: 67007069794 | ACN: 007 069 794

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

I, Alex Bambrick reasonably believe on 01-JUL-2020 at 07:45 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 32

Brief description of how the provision is being or has been contravened:

I observed and photographed access gate to DELTA PTY.LTD. site office situated on Roma St had been left open. You have not fulfilled your duty to provide a safe system prevent unauthorized access to areas where high risk work was being undertaken.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

01-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 02-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

PAUL RYAN
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013710

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019660

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

159 Roma Street, Brisbane Qld. 4000

I, Anzac Teoka reasonably believe on 01-JUL-2020 at 10:00 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(A), 33

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that you, namely CPB Contractors Pty Ltd, have failed to ensure, so far as is reasonably practicable, the provision of a work environment without risks to health and safety. I observed an accessway installed to an electrical appliance access and egress from both ends obstructed by ducting. Persons are at risk of injury collision with plant and slips, trips and falls.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

01-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 03-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MICHAEL FINCH
Notice given to

Health And Safety Representative
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019660

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019705

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

867 Main Street Woolloongabba QLD 4102

I, Christopher Mutton reasonably believe on 02-JUL-2020 at 10:20 that you are contravening a provision of the:

Electrical Safety Act 2002 - section(s) 30(1), 40D
Electrical Safety Regulation 2013 - section(s) 104(5)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure that the temporary electrical switchboards D1, D2, D3 and D4 has meet the requirements of AS/NZ 3012. Temporary electrical switchboards were not lockable.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

02-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 04-JUL-2020

Service method: Delivered directly to the person named

ADAM BAKER
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019705

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013517

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: X-CEL CONSTRUCTION SERVICES PTY LTD

ABN: 82168493105 | ACN: 168493105

Trading as:

Address: 111 RAILWAY AV, STRATHPINE 4500 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

I, Travis Dungey reasonably believe on 07-JUL-2020 at 10:30 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 346(1)

Brief description of how the provision is being or has been contravened:

While on site I observed a storage container used by yourself. While looking in that container I observed and photographed Hazardous Chemicals, these items were Fluoro marking paint and Scaffeze, when I asked for a Hazardous Chemical Register, no register could be produced for the products observed on site.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A PERSON CONDUCTING A BUSINESS OR UNDERTAKING AT A WORKPLACE MUST ENSURE THAT- (A) A REGISTER OF HAZARDOUS CHEMICALS USED, HANDLED OR STORED AT THE WORKPLACE IS PREPARED AND KEPT AT THE WORKPLACE; AND (B) THE REGISTER IS MAINTAINED TO ENSURE THE INFORMATION IN THE REGISTER IS UP TO DATE.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | Inspector's ID | Inspector's contact number

07-JUL-2020 (Date issued) | [redacted] (Inspector's location)

This contravention must be remedied before: 09-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MICHAEL HAUMAHA (Notice given to)

Management Representative For Person Conducting A Business Or Undertaking (Relationship to person to whom notice is issued)

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013517

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013632

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: DELTA PTY. LTD.

ABN: 67007069794 | ACN: 007 069 794

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

Level 4 Coach deck at Roma street Station, Roma Street

I, Simon McLennan reasonably believe on 07-JUL-2020 at 10:45 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 33

Brief description of how the provision is being or has been contravened:

During site inspection I have observed and photographed three generators in operation on level 4 coach deck area, one generator had not been daily pre-started (no record in the attached log book) and the two other generators had not been daily pre-started in over a month. You have failed to maintain the correct daily pre-start requirements as outlined in the manufactures operators manual. This pose a risk for safe operation of plant at the workplace.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE PLANT AND STRUCTURES

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

07-JUL-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 09-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

PAUL RYAN — Notice given to

Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004009

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: FORMCON PTY LTD

ABN: 42166785968 | ACN:

Trading as:

Address: 67 ENKLEMAN DR, YATALA 4207 QLD

Details of contravention:

Site location

LOT 1 ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

I, Lewis Cash reasonably believe on 08-JUL-2020 at 09:20 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 44(4)

Brief description of how the provision is being or has been contravened:

Through consultation with the FORMCON PTY LTD workgroup and Supervisor it was determined ongoing work would be conducted where there is a risk to health associated with the generation of respirable crystalline silica (RCS). The work proposed involves jackhammering concrete piles. It was identified that all workers were fit tested for appropriate RPE but several workers were not clean shaven to ensure the respiratory protective equipment seals and is effective.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

08-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 11-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

DAVID BIEN
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004009

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019666

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

876 Main Street, Woolloongabba. Qld, 4102.

I, Anzac Teoka reasonably believe on 08-JUL-2020 at 08:50 that you are contravening a provision of the:

Electrical Safety Act 2002 - section(s) 30(1), 40D
Electrical Safety Regulation 2013 - section(s) 104(5)

Brief description of how the provision is being or has been contravened:

Observations, inspections and photographs confirm that the electrical equipment does not comply with AS/NZS3012. I observed hot water urn asset no. 102702 displaying an expired test tag in the project crib room.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

08-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 10-JUL-2020

Service method: Delivered directly to the person named

ANZC TE OKA
Notice given to

Other
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019666

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019667

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

876 Main Street, Woolloongabba, Qld .4102.

I, Anzac Teoka reasonably believe on 08-JUL-2020 at 09:40 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(A), 33

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure that common walkways are without risk to health and safety. I observed a high pressure air compressor hose placed across a walkway at approximately head height. Workers are at risk of injury from uncontrolled release of air or collision with hose.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

08-JUL-2020

Date issued

[redacted]

Inspector's location

This contravention must be remedied before: 19-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

MICK NASH

Notice given to

Management Representative For Person With Management Or Control Of A Workplace

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 963

Notice No. I2019667

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013520

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

Details of contravention:

Site location

BOGGO ROAD STATION, , DUTTON PARK 4102 QLD

I, Travis Dungey reasonably believe on 14-JUL-2020 at 10:40 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C), 33

Brief description of how the provision is being or has been contravened:

While on site, I observed and photographed a stair access with timber landings and timber handrail system down to the Station box off the eastern wall, I observed and photographed that the stair access was open for use. When asked no safe system of work could be provided to prove that the system in place could support a persons weight and also the impact generated on the handrail system that had been built. This is putting persons at risk, without a safe system of work in place to give clear direction how to manage any area that requires engineering prior to use of that system.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE SYSTEMS OF WORK;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

14-JUL-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 16-JUL-2020

Service method: Delivered directly to the person named by electronic transmission

PETER CULLEN

Notice given to

Management Representative For Person Conducting A Business Or Undertaking

Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013520

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 24
V15.03.19

RECIPIENT'S COPY

Infringement notice

This notice is issued under the *State Penalties Enforcement Act 1999* section 13 to a person who is contravening or has contravened a provision that has been designated an offence under the Act or Regulation that may attract an infringement notice. This notice requires the person to whom it is issued to ensure payment by the due date unless other available action is taken (refer to reverse side of notice for relevant information).

Notice No. F 2006053

Notice issued to:

Legal name of alleged offender: CPB Contractors Pty Ltd		
ABN: 98000893667	ACN:	
Trading as (if applicable):		
Address: Level 3, 339 Coronation Drive, Milton		
Postcode: 4064		
Date of birth: / /	Gender: ☐ Male ☐ Female ☐ Other	Contact number:
Identification type:	ID number:	

Details of alleged contravention:

Location of offence

30 Joe Bader St Dutton parks.

I, Travis Digby (Inspector name) reasonably believe on 14/7/2020 (date) at 10:30 am (24 hour time)

you committed an infringement notice offence by contravening a provision of the:

- ☐ *Work Health and Safety Act 2011*, section
- ☒ *Work Health and Safety Regulation 2011*, regulation 346(1)
- ☐ *Electrical Safety Act 2002*, section
- ☐ *Electrical Safety Regulation 2013*, regulation
- ☐ *Safety in Recreational Water Activities Act 2011*, section
- ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation

Offence code: 9011

Penalty amount $ 3600 ***Payment must be received within 28 days of the date of this notice unless other available action has been taken (refer to reverse side of notice for relevant information).***

Description of the offence:

(a) PCBU failed to ensure that a register of hazardous chemicals used, handled or stored at the workplace is prepared and kept at the workplace (b) PCBU failed to ensure that the register of hazardous chemicals is maintained so that the information in the register is up to date.

Issuing inspector:

[redacted] Signature of inspector

[redacted]

[redacted] Inspector's contact number

14 / 7 / 2020 Date issued

[redacted] Inspector's work address

Service method:

☒ Delivered personally ☐ Left for a person at the workplace ☐ Registered Post ☐ Fax ☐ Left at the person's last known place of residence or business
☐ Email (Note: Email may only be used with the consent of the notice recipient using their nominated email address)

Peter Cullen — Notice given to

Safety advisor — Relationship to person to whom notice is issued

Information about payment options is detailed on the back of this notice.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the OIR. Note that privacy laws do not apply if other laws conflict with or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

ABN 94 496 188 983

Queensland Government

Infringement

What to do next

You have 28 days from the date of the notice to choose one of the options listed below. A reminder notice will not be issued.

If you don't act by the due date, your fine will be enforced by the State Penalties Enforcement Registry (SPER). This means you'll have to pay additional fees and face enforcement action.

1. Pay the fine

Pay by referencing the infringement notice number and using one of the payment options on this notice. The easiest way to pay is by calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only). OR

Return a copy of this notice with full payment (cheque or money order only) payable to the Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.**

2. Can't pay the full amount

Voluntary instalment plan

If you cannot pay the full amount by the due date and the fine is at least $200, you can make an application for a voluntary instalment plan.

Application can be made before the due date by completing the section below and mailing it to the Office of Industrial Relations with an initial payment of $60 (cheque or money order only). Make the cheque payable to the Office of Industrial Relations, and send to Accounts receivable, PO Box 820, Lutwyche QLD 4030. **Do not mail cash.** OR

By calling 1300 362 128 and using a credit card (American Express, Visa, Mastercard only).

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
Office of Industrial Relations, Accounts receivable, PO Box 820, Lutwyche QLD 4030

An instalment plan will be sent to you by the State Penalty Enforcement Register (SPER). Failure to comply with the instalment plan may result in enforcement by SPER and you will be required to pay additional fees.

3. Take this matter to court

You have the right to elect to have this matter dealt with by a court. This section must be completed, and the complete notice forwarded to the Office of Industrial Relations within 28 days from the date of service of this infringement notice.

You are responsible for obtaining your own legal advice before the court hearing. If found guilty of the offence you may be required to pay costs. If you do not appear on the date set for the hearing, the offence may be heard in your absence.

To be completed by the alleged offender

I, _____ _____
Given name/s Family name

elect to have the matter dealt with by a Court of Law and understand a summons will be issued to me.

Signature: _____ Date: _____

Current address: _____

_____

Contact phone number: _____ Infringement notice number: _____

Complete and return this section to:
SPER Liaison Officer, Office of Industrial Relations, GPO Box 69, Brisbane QLD 4001.

Withdrawal of the infringement notice

This notice may be withdrawn at any time before the penalty is paid in full.
If the notice is withdrawn, the Office of Industrial Relations may determine that further prosecution is warranted.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024121

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

SCAFFOLD AND STAIRS TO STATION BOX, BOGGO ROAD STATION, 30 JOE BAKER STREET, DUTTON PARK

I, Paul Kitchener reasonably believe on 14-JUL-2020 at 15:30 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B), 32

Brief description of how the provision is being or has been contravened:

I observed and photographed two sets of adjustable stretcher stairs connected to a scaffold tower erected inside the station box. The lower stretcher stairs are attached with a half-coupler which is connecting the stairs via bolts and is connected to the scaffold by a ledger and couplers. The upper stairs are attached to a timber plank which is sitting on the scaffold platform deck. There is no engineering for the scaffold and stretcher stairs which are using different components to connect, and no engineering drawing indicating that the design of the scaffold and stairs as currently erected is without risks to health and safety of workers.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Work Health and Safety Act 2011 - section 19(3)(B)
WITHOUT LIMITING SUBSECTIONS 19 (1) AND 19 (2), A PERSON CONDUCTING A BUSINESS OR UNDERTAKING MUST ENSURE, SO FAR AS IS REASONABLY PRACTICABLE THE PROVISION AND MAINTENANCE OF SAFE PLANT AND STRUCTURES

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]	[redacted]	[redacted]
Signature of inspector	Inspector's ID	Inspector's contact number
14-JUL-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	Service method:
18-JUL-2020	Delivered directly to the person named by electronic transmission
BROGUE RINEBARGER	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2024121

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.

I certify that the requirements of this notice have been complied with:

Name *in block letters:* PETER GILLEN Position: SAFETY ADVISOR

Signature [redacted] Date complied: 16/07/2020

ABN 94 496 188 983

Notice No. I2024121

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 17

Application for internal review of decision

V22.08.2018

Work Health and Safety Act 2011. Electrical Safety Act 2002. Safety in Recreational Water Activities Act 2011

Complete this form to apply for an internal review of decision under the *Work Health and Safety Act 2011, Work Health and Safety Regulation 2011, Electrical Safety Act 2002* or *Safety in Recreational Water Activities Act 2011.*

Please read the *Internal review of decisions: Guidance for applicants* information sheet prior to completing this form.

It is your responsibility to ensure you have completed the required fields and supplied all required documents. Incomplete applications will be returned to you and will result in delays in the review process. The review timeframes only apply from the date when all required information is received.

Section a: Application details

1. Applicant details

Are you making this application as: ☐ an individual applicant? ☑ on behalf of a company, government department or other body corporate?
Provide your details below. If you are the applicant's legal or union representative you will also need to provide your details.
Name of applicant/company/government department/body corporate: **CBP Contractors Pty Ltd**
Name of contact person (if not the same as applicant): **Mick Nash**
Postal address: [redacted]
Postcode: [redacted] Phone: [redacted] Fax:
Email: [redacted]
Can we send the decision by email? ☑ Yes ☐ No

2. Under which legislation are you applying for review?

☑ *Work Health and Safety Act 2011* *Go to section 3a*	☐ *Work Health and Safety Regulation 2011* *Go to section 3b*
☐ *Electrical Safety Act 2002* *Go to section 3c*	☐ *Safety in Recreational Water Activities Act 2011* *Go to section 3d*

3. Which decision would you like reviewed? *Complete section a, b, c or d. If the decision is not in the list it cannot be reviewed.*

a) The inspector's decision under the *Work Health and Safety Act 2011* in relation to the:

☐ failure of negotiations – section 54 (2)	☐ extension of time for an improvement notice – section 194
☐ training of health and safety representatives – section 72 (6)	☐ issue of a prohibition notice – section 195
☐ health and safety committees – section 76 (6)	☐ issue of a non-disturbance notice – section 198
☐ review of a provisional improvement notice – section 102	☐ issue of a subsequent notice – section 201
☑ issue of an improvement notice – section 191	☐ refusal to make any of the above decisions *(please specify below)*

If you require more space, attach a separate sheet outlining your response

b) A reviewable decision under Chapter 11 of the Work Health and Safety Regulation 2011

- ☐ High risk work licence
- ☐ Demolition work licence
- ☐ General Induction Training (construction)
- ☐ other decision *(please specify below)*
- ☐ Accreditation of assessors
- ☐ Asbestos licence
- ☐ Major hazard facility

If you require more space, attach a separate sheet outlining your response

c) an original decision under the Electrical Safety Act 2002 (including the Electrical Safety Regulation 2013)

- ☐ issue of an improvement notice, s146
- ☐ issue of an electrical safety protection notice, s147
- ☐ issue of a non-disturbance notice, s149
- ☐ a decision about the issue, removal or re-instatement of an electrical licence under Part 4 of the *Electrical Safety Act 2002*
- ☐ extension of time for an improvement notice, s146C
- ☐ issue of an unsafe equipment notice, s148
- ☐ issue of a subsequent notice, s149C
- ☐ other decision *(please specify below)*

If you require more space, attach a separate sheet outlining your response

d) The inspector's decision under the *Safety in Recreational Water Activities Act 2011* applied section of the *Work Health and Safety Act 2011* in relation to the:

- ☐ issue of an improvement notice, s191
- ☐ extension of time for an improvement notice, s194
- ☐ issue of a prohibition notice, s195
- ☐ issue of a non-disturbance notice, s198
- ☐ issue of a subsequent notice, s201
- ☐ refusal to make any of the above decisions *(please specify below)*

If you require more space, attach a separate sheet outlining your response

4. Date the decision was made or notice issued

Date: 20 / 07 / 2020

5. Which of the following applies to you as being eligible to seek a review?

- [ ] a worker or his/her representative who is affected by the decision
- [x] a person conducting a business or undertaking who is affected by the decision
- [ ] the person with management or control of the workplace, plant or substance
- [ ] a person who received a notice
- [ ] a health and safety representative who represents a worker who is affected by the decision
- [ ] a health and safety representative who issued a provisional improvement notice
- [ ] a person whose interests are affected by an original decision (*Electrical Safety Act 2002*)
- [ ] an eligible person under Part 11 of the *Work Health and Safety Regulation 2011*

6. If this application is lodged outside the prescribed time, provide a reasonable explanation for the delay

Note: In general the prescribed time is 14 days unless the matter is in relation to an improvement notice. The prescribed time for matters relating to an improvement notice is whichever is lesser – 14 days or the period stated for compliance in the notice. Applications for a review of a decision to forfeit a thing under the *Electrical Safety Act 2002* or a review of decision under Part 11 of the *Work Health and Safety Regulation 2011* can be made within 28 days of receiving the notice of the original decision.

If you require more space, attach a separate sheet outlining your response

7. Decision for review

Select one option

- [x] attached is a copy of the decision to be reviewed
- [ ] a description of the decision for review is provided below

Include the number of the notice, date the decision was made, name of the inspector or officer who made the decision, date you received notice of the decision and any other relevant details.

If you require more space, attach a separate sheet outlining your response

8. Why do you think the decision should be reviewed?

Select one option

You may attach additional information to support your request.

We respectfully request a letter outlining our submission to support the review application and any supporting evidence be provided by cob 24th of July 2020

If you require more space, attach a separate sheet outlining your response

9. Are you seeking a stay (i.e. suspension) of the decision?

*If you wish to have a decision relating to a **non-disturbance, prohibition notice, unsafe equipment notice or electrical safety protection notice** stayed you must apply for a stay of the decision. Stays are automatically granted for all other reviews of decisions under the Work Health and Safety Act 2011, Electrical Safety Act 2002 and Safety in Recreational Water Activities Act 2011.*

Note: You cannot apply for a stay of a reviewable decision under Chapter 11 of the Work Health and Safety Regulation 2011

☐ No ☐ Yes If yes, why should the operation of the decision be stayed during the determination of the review?

If you require more space, attach a separate sheet outlining your response

Section B: Signature

10. Signature of applicant or applicant's legal representative *(not required where lodged via email)*

Name: **Mick Nash**

Signature: [redacted]

Date: **20** / **07** / **2020**

Section C: Lodging your application

Submit your completed application to the **Internal Review Officer** by email or post.

Email: whsrod@oir.qld.gov.au

Post: Licensing and Advisory Services
Office of Industrial Relations
PO Box 820
LUTWYCHE QLD 4030.

Applications will only be accepted and processed when all required fields on the form have been completed and the relevant supporting information (if required) has been supplied. Incomplete applications will be returned to the applicant.

Lodgement timeframes

If your application relates to an improvement notice, lodge your application before the compliance date on the notice or within 14 days of the date the notice was issued (whichever is earlier).

If your application relates to a review of a decision to forfeit a thing under the *Electrical Safety Act 2002*, or a review of a decision under Part 11 of the *Work Health and Safety Regulation 2011*, lodge your application within 28 days of receiving the notice of the original decision.

Applications for all other reviewable decisions under the *Work Health and Safety Act 2011*, *Electrical Safety Act 2002* and *Safety in Recreational Water Activities Act 2011* should be lodged within 14 days of the date on which the decision was advised.

Lodgement outside these timeframes may be permitted in some circumstances. The reviewer will consider a number of factors including your explanation for the late lodgement, whether it would adversely affect anyone else if the application were to be accepted and the views of the original decision maker.

What happens next?

You will be provided with written confirmation that your application has been received. A decision on the review will be made within 14 days of receipt of the application*. The decision may confirm or vary the original decision or substitute the original decision for another decision. Once a decision has been made, you will be provided with written confirmation of the decision and the reasons for it.

** A review of a decision about the issue, removal or re-instatement of an electrical licence under the Electrical Safety Act 2002 is made by the Electrical Licensing Committee. Reviews made by the Committee are not subject to 14 days but are made as soon as is reasonably practicable.*

Further information

For further information about internal reviews of decisions visit worksafe.qld.gov.au or phone 1300 362 128.

NOTE: Notification to Workplace Health and Safety Queensland (WHSQ) or the Electrical Safety Office (ESO) is not a notification to Work Cover Queensland. If you have any questions about filling out the form, please call 1300 362 128. Please keep a copy of this form for your own records before submission.

External review

If your review is unsuccessful you may apply to the Queensland Civil and Administrative Tribunal (QCAT) for an external review of the decision.

For more information go to: worksafe.qld.gov.au/laws-and-compliance/compliance-and-enforcement/workplace-inspections/review-of-decisions

PRIVACY STATEMENT: The Office of Industrial Relations is collecting your personal information in order to process your application for an internal review of a decision in accordance with s214 of the *Work Health and Safety Act 2011*, s678 of the *Work Health and Safety Regulation 2011*, s168 of the *Electrical Safety Act 2002*, or s35 of the *Safety in Recreational Water Activities Act 2011*. Our office may disclose your personal information to Commonwealth, state or territory regulator/s in order to obtain information relevant to making a decision on your application. © State of Queensland 2019.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019709

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

847 Main Street, Woolloongabba QLD 4102

I, Christopher Mutton reasonably believe on 21-JUL-2020 at 12:30 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 40(A)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure that the layout of the workplace allows a person to enter and exit without risk to health and safety both in normal conditions and in an emergency. No pedestrian signage to warn workers of on-coming live traffic. Risk of collision which would cause injury.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

21-JUL-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 22-JUL-2020

Service method: Delivered directly to the person named

BROGUE RINEBARGER
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019709

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004021

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

Lot 2, Albert St Station, Albert St, Brisbane

I, Lewis Cash reasonably believe on 03-AUG-2020 at 11:10 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B)

Brief description of how the provision is being or has been contravened:

CPB Contractors Pty Limited have failed to ensure plant namely soft slings are stored correctly to ensure they are not damaged or contaminated within the workplace which may lead to failure. I observed 20 tonne soft sling on the ground where it was laying amongst dirt, water and substance appearing to be oil giving rise to the risk of damage and contamination which may cause failure.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

SUSAN SARLANIS — Notice given to

Management Representative For Person With Management Or Control Of A Workplace — Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004021

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004022

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

Lot 1, Albert Street Station, Albert St, Brisbane

I, Lewis Cash reasonably believe on 03-AUG-2020 at 14:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 78(1)

Brief description of how the provision is being or has been contravened:

CPB Contractors Pty Limited failed to manage risks to health and safety associated with a fall by a person from one level to another that is reasonably likely to cause injury to the person or any other person.
I observed areas around lot 1 where visual barriers including unfilled water barriers and crowd control barriers, have been erected near the edge as a control for falls from one level to another. There is the potential to fall down onto exposed reo, uneven ground and fall risk between shoring erected where workers access to and from the area.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

KOSHIV NIRANJAN
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2004022

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2004647

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of contravention:

Site location

Lot 2, Albert Street Station, Albert St, Brisbane

I, Young Min Lee reasonably believe on 03-AUG-2020 at 11:20 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C)

Brief description of how the provision is being or has been contravened:

CPB Contractors Pty Limited have failed to ensure, so far as is reasonably practicable the provision and maintenance of safe systems of work.
I observed multiple issues regarding access and egress around site including: worker dogging a suspended load while climbing over a concrete barrier, not using designated accessways; vertically stacked steel reinforced bars; and inadequate access to the generator impeded by air line and rubber hose.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

SUSAN SARLANIS
Notice given to

Management Representative For Person With Management Or Control Of A Workplace
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: [redacted] Date complied: / /

ABN 94 496 188 983

Notice No. I2004647

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019679

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: BOGGO ROAD STATION, , DUTTON PARK 4102 QLD	

Details of contravention:

Site location

Boggo Road, Dutton Park. Qld, 4102

I, Anzac Teoka reasonably believe on 03-AUG-2020 at 11:30 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure a safe system of work was implemented. Worker/s were using the ALISAFE mobile access platform whilst loading a truck without all brakes applied on the wheels, not on a level surface as per the manufacturers specifications. Workers were not provided with instruction or training in use of the ALISAFE mobile access platform. I observed the platform to be unstable and not all wheels touching the ground.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector	Inspector's ID	Inspector's contact number
03-AUG-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	**Service method:**
14-AUG-2020	Delivered directly to the person named by electronic transmission
PETER CULLEN	Management Representative For Person With Management Or Control Of A Workplace
Notice given to	Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013526

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD

Details of contravention:

Site location

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Travis Dungey reasonably believe on 03-AUG-2020 at 10:40 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(B)

Brief description of how the provision is being or has been contravened:

While walking the delineated walkway areas on site. I observed and photographed that water filled barriers used for plant and personnel delineation on site had no evidence that they are a compliant system when asked no personnel on site could supply myself with evidence that the barriers used could be used for that purpose and would be an adequate system, also some were not filled with water to separate mobile plant and pedestrians. This is putting workers at risk of being struck by mobile plant in those area as a result and being injured.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Without limiting subsections 19 (1) and 19 (2), a person conducting a business or undertaking must ensure, so far as is reasonably practicable the provision and maintenance of safe plant and structures;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 06-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013526

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013527

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Travis Dungey reasonably believe on 03-AUG-2020 at 11:00 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(C)

Brief description of how the provision is being or has been contravened:

I observed and photographed, that a handrail component had been removed on the Calbah stair access to the station box, conversation with personnel on site could not confirm why the handrail extension had been removed, with out a safe system of work in place to manage that handrail system this could happen again and put workers at risk of falls again when using that main access to the station box.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

Without limiting subsections 19 (1) and 19 (2), a person conducting a business or undertaking must ensure, so far as is reasonably practicable the provision and maintenance of safe systems of work;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]	[redacted]	[redacted]
Signature of inspector	Inspector's ID	Inspector's contact number
03-AUG-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before:	**Service method:**
06-AUG-2020	Delivered directly to the person named by electronic transmission
BRENDAN TAYLOR	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013528

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD

Details of contravention:

Site location

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Travis Dungey reasonably believe on 03-AUG-2020 at 13:30 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(D)

Brief description of how the provision is being or has been contravened:

While looking in storage container WE7654 I observed and photographed Hilti explosive chargers being stored in that container I asked personnel on site for a Safety data sheet for that item but no Safety data sheet could be supplied while I was on site for that item. This poses a risk to workers on site with out havening that Safety data sheet available to indicate how to use handle and store this item safely.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013528

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2013529

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 148. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

867 MAIN ST , WOOLLOONGABBA 4102 QLD

I, Travis Dungey reasonably believe on 03-AUG-2020 at 13:00 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(C)

Brief description of how the provision is being or has been contravened:

While inspecting the site I observed and it was noted that workers weren't using delineated walk ways and were crossing and entering areas that are not for pedestrian use for access. Workers are at risk as entry to those area's is not controlled properly by maintaining or providing a safe system in relation to the access and egress on site.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Without limiting subsections 19 (1) and 19 (2), a person conducting a business or undertaking must ensure, so far as is reasonably practicable the provision and maintenance of safe systems of work;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]	[redacted]	[redacted]
Signature of inspector	Inspector's ID	Inspector's contact number
03-AUG-2020	[redacted]	
Date issued	Inspector's location	

This contravention must be remedied before: 06-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: [redacted] JOHN KARAJI Position: Senior Safety

Signature: [redacted] Date complied: 6/8/20.

ABN 94 496 188 983

Notice No. I2013529

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

RECIPIENT'S COPY

Form 13

Improvement notice

Notice No. 2019680

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.

Notice issued to:

Legal name of person/business or undertaking: CPB Contractors Pty Ltd

ABN: 98 000 893 667 ACN:

Trading as:

Address: Level 6 HQ South Tower 52A Wickham St Fortitude Valley Postcode: 4006

Details of contravention:

Site location

Pacific Rd, Ormeau Park QLD 4208

I, Aaron Te Oka reasonably believe on 03-08-2020 at 1230

Inspector name date 24 hour time

that you ☑ are contravening a provision or ☐ have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated; of the:

☐ *Work Health and Safety Act 2011*, section/s ____ ☑ *Work Health and Safety Regulation 2011*, regulation/s 34AA(3)(a)

☐ *Electrical Safety Act 2002*, section/s ____ ☐ *Electrical Safety Regulation 2013*, regulation/s ____

☐ *Safety in Recreational Water Activities Act 2011*, section/s ____ ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation/s ____

Brief description of how the provision is being or has been contravened:

Person conducting a business or undertaking with contractors who relevant persons [illegible] the PCBU had failed to implement adequate [illegible] protection at the [illegible] road [illegible] observed concrete edge protection less than 900 mm high

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

[illegible] between the [illegible] batters 470mm wide. Persons are at [illegible] from falling greater than 3 metres

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector: [redacted]

Signature of inspector [redacted] Inspector's ID [redacted] Inspector's contact number [redacted]

Date issued 03/08/2020 Inspector's location Robina

This contravention must be remedied before: 07/08/2020

Service method:

☑ Delivered personally ☐ Left for a person at the workplace ☐ Post
☐ Fax ☐ Email
☐ Left at the person's last known place of residence or business

Notice given to Shane Bradley Relationship to person to whom notice is issued Site Superintendant

This portion may be signed and returned where a contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name (in block letters): Peter Cullen Position: Snr Safety Advisor

Signature: [redacted] Date complied: 03/08/2020

ABN 54 496 188 [illegible]

Notice No. 2019680

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

RECIPIENT'S COPY

Form 13

Improvement notice

Notice No. I 2019710

V1.3.18

Work Health and Safety Act 2011. Electrical Safety Act 2002. Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LTD

ABN: 98 000 893 667 ACN:

Trading as:

Address: Level 6/ HQ south tower - 526 WICKHAM ST, FORTITUDE VALLEY QLD

Postcode: 4006

Details of contravention:

Site location

BOGGO RD, DUTTON PARK QLD 4102

I, Christopher Mutton (Inspector name) reasonably believe on 3/8/2020 (date) at 12:06 pm (24 hour time)

that you ☒ are contravening a provision or ☐ have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated; of the:

☐ *Work Health and Safety Act 2011*, section/s _____ ☒ *Work Health and Safety Regulation 2011*, regulation/s 40(A)

☐ *Electrical Safety Act 2002*, section/s _____ ☐ *Electrical Safety Regulation 2013*, regulation/s _____

☐ *Safety in Recreational Water Activities Act 2011*, section/s _____ ☐ *Safety in Recreational Water Activities Regulation 2011*, regulation/s _____

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant person confirm that the PC (PCBU) has failed to ensure that a safe system of access and egress for persons to enter and exit and move about without risk to health and safety in normal work conditions and in an emergency. Workers are at risk of collision with mobile plant which would cause injury.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector: [redacted]

Signature of inspector [redacted] Inspector's ID [redacted] Inspector's contact number [redacted]

Date issued 3/8/2020 Inspector's location Robina

This contravention must be remedied before: 7/8/2020

Service method:

☒ Delivered personally ☐ Left for a person at the workplace ☐ Post

☐ Fax ☐ Email

☐ Left at the person's last known place of residence or business

Notice given to Pete CULLEN

Relationship to person to whom notice is issued SENIOR SAFETY ADVISOR

This portion may be signed and returned where a contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name (in block letters): _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I 2019710

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil these functions.

180

Queensland Government

RECIPIENT'S COPY

Form 13

Improvement notice

Notice No. I 2019711

V1.3.18

Work Health and Safety Act 2011. Electrical Safety Act 2002. Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LTD

ABN: 98 000 893 667 ACN:

Trading as:

Address: LEVEL 6 / HQ SOUTH TOWER 526 WICKHAM STREET, FORTITUDE VALLEY QLD. Postcode: 4006.

Details of contravention:

Site location

BOGGO RD, DUTTON PARK QLD 4102

I, Christopher Mutton (Inspector name) reasonably believe on 3/8/2020 (date) at 1458 (24 hour time)

that you [X] are contravening a provision or [ ] have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated; of the:

- [ ] *Work Health and Safety Act 2011*, section/s
- [X] *Work Health and Safety Regulation 2011*, regulation/s 298 (1)
- [ ] *Electrical Safety Act 2002*, section/s
- [ ] *Electrical Safety Regulation 2013*, regulation/s
- [ ] *Safety in Recreational Water Activities Act 2011*, section/s
- [ ] *Safety in Recreational Water Activities Regulation 2011*, regulation/s

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure that site security was established on the bus way. Unauthorised persons

~~Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:~~
It is mandatory to comply with these directions

2m.

can access the incomplete scaffold and there is a risk that would cause injury.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted] Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

3 / 8 / 2020 Date issued

Pabang Inspector's location

This contravention must be remedied before:

5 / 8 / 2020

Service method:

- [X] Delivered personally
- [ ] Left for a person at the workplace
- [ ] Post
- [ ] Fax
- [ ] Email
- [ ] Left at the person's last known place of residence or business

PETE CULLEN Notice given to

SENIOR SAFETY ADVISOR Relationship to person to whom notice is issued

This portion may be signed and returned where a contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name (in block letters): Position:

Signature: Date complied: / /

ABN 94 496 188 983

Notice No. I 2019711

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024128

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD

Details of contravention:

Site location

Woolloongabba Station CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 13:45 that you are contravening a provision of the:
Work Health and Safety Regulation 2011 - regulation 346(1)

Brief description of how the provision is being or has been contravened:

I observed and photographed a corrosive hazardous chemical (Hilti RE 500 V3). The chemical is included on the hazardous chemical register; however, the Safety Data Sheet for the substance is incomplete and only shows up to element 8 of 12. The SDS does not show storage or compatibility requirements for the substance. You have not ensured that the register is maintained to ensure information is up to date.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 346(1)
A person conducting a business or undertaking at a workplace must ensure that- (a) a register of hazardous chemicals used, handled or stored at the workplace is prepared and kept at the workplace; and (b) the register is maintained to ensure the information in the register is up to date

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2024128

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024129

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

Woolloongabba Station CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 12:00 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Regulation 2011 - regulation 351(1)

Brief description of how the provision is being or has been contravened:

I observed and photographed four (4) 20 litre yellow plastic fuel containers for the storage of distillate (diesel) fuel. The containers were mostly empty, and sitting on a bunded area in full sunlight. The containers are labelled indicating the product should not be stored in the direct sunlight. I was informed by a CPB representative that the containers were considered 'in use' which is why they were on a bund, and that this is accepted practice for the worksite. The Safety Data Sheet for the product indicates it should not be stored in direct sunlight. You have not managed the risks to health and safety associated with using or handling a hazardous chemical.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 351(1)
A person conducting a business or undertaking must manage, under part 3.1, risks to health and safety associated with using, handling, generating or storing a hazardous chemical at a workplace.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector

[redacted] Inspector's ID

[redacted] Inspector's contact number

03-AUG-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2024129

V1.3.18 *Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011*

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2024129

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Internal review of decision

An eligible person whose interests are affected by an original decision may apply for the decision to be reviewed. Refer to the Internal review of decision ? guide for applicants, at www.worksafe.qld.gov.au

An eligible person is:

1. The person to whom the notice was issued.
2. A person conducting a business or undertaking whose interests are affected by the decision.
3. A worker whose interests are affected by the decision.
4. A health and safety representative who represents a worker whose interests are affected by the decision.

How does a person apply for a review of a decision?

The application for internal review must:

a) be made in the approved form to the reviewer

b) supported by enough information to enable the reviewer to decide the application

An application for internal review relating to an improvement notice issued under the *Work Health and Safety Act 2011* and the *Safety in Recreational Water Activities Act 2011* must be lodged before the date stated in the notice for compliance or within 14 calendar days of the decision coming to the notice of the eligible person, whichever is the lesser.

For an improvement notice issued under the *Electrical Safety Act 2002*, the application for internal review must be made within 14 days after the day the applicant receives the notice.

Lodgement of the form can be made via email whsrod@oir.qld.gov.au. Information about how to apply for an internal review of decision, including the application form, is available at www.worksafe.qld.gov.au or by calling 1300 362 128. There is no application fee.

The operation of the improvement notice is stayed (suspended) once the application for review of decision is lodged. The stay remains in effect until a decision is made by the internal reviewer and whichever of the following is earlier ? an external review is applied for or, 28 days have elapsed since the person became aware of the decision.

What happens next?

The internal reviewer must make a decision within 14 calendar days of receiving the application for internal review. The internal reviewer can confirm or vary the reviewable decision, or set aside the reviewable decision and substitute the original decision for another decision. Once the internal reviewer makes the decision, they must notify the applicant of the decision and the reasons for the decision in writing.

External review

An eligible person may apply to an external review body for a review of the internal decision of the internal decision reviewer, or the original decision of the regulator. From the day the applicant received or became aware of the decision, an application for external review must be made within:

- 30 calendar days to the Queensland Industrial Relations Commission (QIRC) relating to the *Work Health and Safety Act 2011*;
- 28 calendar days to the Queensland Civil Administration Tribunal (QCAT) relating to the *Electrical Safety Act 2002* or the *Safety in Recreational Waters Act 2011*.

QCAT and QIRC may confirm or vary the original decision, set aside the original decision and substitute another decision or set aside the original decision and return the matter to the decision maker with appropriate directions.

Please refer to www.worksafe.qld.gov.au or phone 1300 362 128 for more information on how to apply for an external review.

Privacy collection statement

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by the OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

The OIR's privacy information is on our website at www.worksafe.qld.gov.au.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2024130

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

Woolloongabba Station CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 13:00 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(B)

Brief description of how the provision is being or has been contravened:

I observed and photographed site guardrail which is erected around the station box at the workplace. The guardrail has in places various different attachments, including electricity, water conduits and air lines. The manufacturer's installation instructions and correspondence to CPB states that the system is designed for guardrail loading but 'not for attaching additional equipment'. There was no engineer sign off to show the guardrail is structurally able to take the load of the additional equipment attached. You have not ensured so far as reasonably practicable the provision and maintenance of safe structures.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Act 2011 - section 19(3)(B)
Without limiting subsections 19 (1) and 19 (2), a person conducting a business or undertaking must ensure, so far as is reasonably practicable the provision and maintenance of safe plant and structures;

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing Inspector:

[redacted] | [redacted] | [redacted]
Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]
Date issued | Inspector's location

This contravention must be remedied before:	Service method:
06-AUG-2020	Delivered directly to the person named by electronic transmission
BRENDAN TAYLOR Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: BRENDAN TAYLOR **Position:** PM

Signature: [redacted] **Date complied:** 6/8/20

ABN 94 496 188 983

Notice No. I2024130

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

V1.3.18

Notice No. I2024130

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $60,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

V1.3.18

Notice No. I2024131

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD

Details of contravention:

Site location

Site Security Area Leopard Street Gate, Woolloongabba CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 11:15 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Act 2011 - section(s) 19(3)(A)

Brief description of how the provision is being or has been contravened:

I observed and photographed a delivery driver enter site from Leopard Street. I observed the driver have conversations with the site security officer, forklift operator and also a site safety officer. Discussions with the site security officer identified that security does not perform a COVID19 triage with delivery drivers unless they are entering site (driving into the site past the loading area). There was no identification of where the driver had been, no COVID declaration by him and no system in place to identify any potential COVID transmission. There was a sign on the office advising all delivery drivers must wear a face mask; I was advised by a site safety officer that masks are no longer required and it is an outdated sign. You have not ensured the provision of a work environment without risks to health and safety in relation to potential COVID19 transmission from delivery drivers.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Work Health and Safety Act 2011 - section 19(3)(A)
Without limiting subsections 19 (1) and 19 (2), a person conducting a business or undertaking must ensure, so far as is reasonably practicable, the provision and maintenance of a work environment without risks to health and safety

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

03-AUG-2020
Date issued

[redacted] Inspector's location

This contravention must be remedied before: 05-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2024131

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: BRENDAN TAYLOR Position: PM

Signature: [redacted] Date complied: 4/8/20

Notice No. I2024131

ABN 94 495 188 963

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 RECIPIENT'S COPY

Improvement notice

Notice No. I2024132

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD	

Details of contravention:

Site location

Storage Area Woolloongabba CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 12:00 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 78(2)

Brief description of how the provision is being or has been contravened:

I observed and photographed an storage area where equipment including form-ply, stillages of geofabric and a pallet of steel components which is accessible by persons to obtain equipment. There is a live edge from where a person could fall from a height of at least 600mm with no means of protection to prevent a fall from one level to another. You have not managed the risk to health and safety associated with a fall by a person from one level to another.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

A person conducting a business or undertaking at a workplace must, under part 3.1, manage risks to health and safety associated with a fall by a person from one level to another that is reasonably likely to cause injury to the person or any other person.
Work Health and Safety Regulation 2011 - regulation 78(2)
Subsection (1) includes the risk of a fall (a)in or on an elevated workplace from which a person could fall; or (b)in the vicinity of an opening through which a person could fall; or (c)in the vicinity of an edge over which a person could fall; or (d)on a surface through which a person could fall; or (e)in any other place from which a person could fall.

Recommendations (if any): it is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] | [redacted] | [redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

03-AUG-2020 | [redacted]

Date issued | Inspector's location

This contravention must be remedied before:	Service method:
06-AUG-2020	Delivered directly to the person named by electronic transmission
BRENDAN TAYLOR	Management Representative For Person Conducting A Business Or Undertaking
Notice given to	Relationship to person to whom notice is issued

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13

RECIPIENT'S COPY

Improvement notice

Notice No. I2024132

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: SLOVDAN TAYLOR Position: PM

Signature: [redacted] Date complied: 6/8/24

ABN 94 496 188 983

Notice No. I2024132

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1023835

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: ALBERT STREET STATION, ALBERT ST, BRISBANE 4000 QLD

Details of serious risk:

Site location — Direction given orally: Y

Lot 2, Albert St Station, Albert St, Brisbane

I, Lewis Cash reasonably believe on 03-AUG-2020 at 12:20 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B)

I direct the person with control over the following activity to stop the activity of: Use of the 20T soft sling covered in dust, water and a substance appearing to be oil

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I observed a 20T soft sling laying on the ground and covered in dust, water and substance appearing to be oil. There is inadequate information regarding the integrity of the sling, giving rise to the risk of damage and failure in plant.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] — Signature of inspector

[redacted] — Inspector's ID

[redacted] — Inspector's contact number

03-AUG-2020 — Date issued

[redacted] — Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

SUE SARLANIS — Notice given to

Management Representative For Person With Management Or Control Of A Workplace — Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

FORM 12 **RECIPIENT'S COPY**
V1.1.12

Prohibition notice

This notice is issued under the *Work Health and Safety Act 2011* section 195 or the *Safety in Recreational Water Activities Act 2011* applied section 195 *Work Health and Safety Act 2011* (which includes a body corporate, government department or public authority) who has or may be reasonably presumed to have control over the prohibited activity. This notice prohibits an activity which involves or will involve an immediate or imminent risk to the health and safety of any person. **The legislation requires that the person to whom a prohibition notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Queensland Government
ABN 94 496 188 983

Work Health and Safety Act 2011
Safety in Recreational Water Activities Act 2011

Notice No. P1025038

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: 867 MAIN ST , WOOLLOONGABBA 4102 QLD

Details of serious risk:

Site location — Direction given orally: Y

Access Walkway from laydown area to decline, Woolloongabba Station CRR

I, Paul Kitchener reasonably believe on 03-AUG-2020 at 10:45 that an activity is occurring at the workplace that involves a serious risk to the health or safety of a person emanating from an immediate or imminent exposure to a hazard and that this activity is contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 40(A)

I direct the person with control over the following activity to stop the activity of: Use of access walkway between laydown area and decline

until an inspector is satisfied that the matters that give rise to the risk have been remedied.

Basis for inspector's belief:

I observed and photographed an access walkway between the laydown area and the decline into the station box at the workplace. The walkway is delineated by plastic water barriers which are not rated for impact by traffic. There is traffic flow on both sides of the walkway, including Prime Mover trucks with tandem trailers. Many of the plastic barriers are not filled with water or joined; the occasional barrier had some manner of damage. You have not ensured, so far as reasonably practicable, that the workplace is maintained to allow persons to enter and exit and to move about without risk to health and safety.

Directions (if any) on the measures to be taken to remedy the risk, activities or matters or the contravention or likely contravention: It is mandatory to comply with these directions

Work Health and Safety Regulation 2011 - regulation 40(A)
A person conducting a business or undertaking at a workplace must ensure, so far as is reasonably practicable, the following- (a) the layout of the workplace allows, and the workplace is maintained so as to allow, for persons to enter and exit and to move about without risk to health and safety, both under normal working conditions and in an emergency;

Recommendations (if any): Recommendations may be followed or you may adopt and follow another way that gives at least the same level of protection against the risk

Issuing inspector:

[redacted] — Signature of inspector
[redacted] — Inspector's ID
[redacted] — Inspector's contact number
03-AUG-2020 — Date issued
[redacted] — Inspector's location

Service method:

Delivered directly to the person named by electronic transmission

BRENDAN TAYLOR — Notice given to
Management Representative For Person Conducting A Business Or Undertaking — Relationship to person to whom notice is issued

Information about how to obtain a review of this decision is detailed on the back of this notice.

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice.

You must comply with this notice. Failure to comply may incur a maximum penalty of $100 000 for an individual and $500 000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of the Department. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by Office of Industrial Relations to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.
The Office of Industrial Relations privacy information is on our website at www.workfsafe.qld.gov.au/.

Internal review of decision

If a decision to prohibit an activity was made by an inspector, an eligible person may apply for an internal review of that decision.

An eligible person is:

1. The person to whom the notice was issued.
2. The person with management or control of the workplace, plant or substance.
3. A person conducting a business or undertaking whose interests are affected by the decision.
4. A worker whose interests are affected by the decision.
5. A health and safety representative who represents a worker whose interests are affected by the decision.
6. A health and safety representative who gave a direction under section 85 of the *Work Health and Safety Act 2011* to cease work, that is relevant to the prohibition notice.

How does a person apply for a review of a decision?

The person must complete and lodge the Internal Review Application form within 14 days of receiving the notice. There is no application fee.

The operation of the prohibition notice continues unless a separate application is made to stay (that is suspend) the prohibition while the review is undertaken. The regulator may or may not grant the stay. The regulator will make a decision on the stay within one working day after the regulator receives the application.

If a stay is granted, it remains in effect until a decision is made by the regulator and whichever of the following is earlier - an external review is applied for or 28 days have elapsed since the person became aware of the regulator's decision.

Information about how to apply for a review of decision, including application forms, is available online at www.worksafe.qld.gov.au, or by phoning Advisory Services on 1300 362 128.

What happens next?

Applications are reviewed within 14 days unless additional information is required. Applicants are provided with written confirmation of the result of the internal review including the reasons for the decision.

External review

If a decision to prohibit an activity was made by the regulator or the regulator has made a decision through internal review, an eligible person may apply to the Queensland Civil and Administrative Tribunal for an external review. An external review application must be made within 28 days of the person becoming aware of the regulator's decision.

Please refer to www.worksafe.qld.gov.au for more information on how to apply for an external review.

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2013530

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: THE RIX GROUP PTY LTD

ABN: 50092239113 | ACN:

Trading as:

Address: ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

Details of contravention:

Site location

ROMA STREET STATION, ROMA ST, BRISBANE CITY 4000 QLD

I, Travis Dungey reasonably believe on 04-AUG-2020 at 10:00 that you have contravened a provision in circumstances that make it likely that the contravention will continue or be repeated of the:

Work Health and Safety Regulation 2011 - regulation 300(1)

Brief description of how the provision is being or has been contravened:

While on site reviewing your Safe Work Method statement. It stated that a current Vehicle Management Plan would be supplied and consulted with the workers. Conversations with telescopic handler mobile plant operator indicated that the (VMP) had not been supplied or communicated prior to work commencing. As a result you have not worked in accordance with the Safe Work Method Statement.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:

It is mandatory to comply with these directions

A person conducting a business or undertaking that includes the carrying out of high risk construction work must put in place arrangements for ensuring that high risk construction work is carried out in accordance with the safe work method statement for the work.

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted] Signature of inspector | [redacted] Inspector's ID | [redacted] Inspector's contact number

04-AUG-2020 Date issued | [redacted] Inspector's location

This contravention must be remedied before:	**Service method:**
07-AUG-2020	Delivered directly to the person named by electronic transmission
MARK LEVINSON (Notice given to)	Management Representative For Person Conducting A Business Or Undertaking (Relationship to person to whom notice is issued)

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2013530

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT

The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019712

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED	
ABN: 98000893667	ACN: 000893667
Trading as: CBGU D&C JV	
Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD	

Details of contravention:

Site location

Roma Street Station, Roma Street Brisbane City QLD 4000

I, Christopher Mutton reasonably believe on 04-AUG-2020 at 09:15 that you are contravening a provision of the:
Work Health and Safety Act 2011 - section(s) 19(3)(C)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the principal contractor failed to ensure that PCBU was working in accordance with there safe systems of work. Principal Contractor safety management plan illustrated on page 37, that the principal contractor will undertake/must review SWMS on a regularly basis. PCBU failed to develop or implement their vehicle movement plan ensuring safe movement of mobile plant and workers. Workers at risk of collision with heavy mobile plant which will cause injury.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

04-AUG-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before:	**Service method:**
08-AUG-2020	Delivered directly to the person named
PETER EVERILL Notice given to	Management Representative For Person Conducting A Business Or Undertaking Relationship to person to whom notice is issued

---

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019712

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2019713

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: CPB CONTRACTORS PTY LIMITED

ABN: 98000893667 | ACN: 000893667

Trading as: CBGU D&C JV

Address: LEVEL 6 SOUTH TOWER, 520 WICKHAM ST, FORTITUDE VALLEY 4006 QLD

Details of contravention:

Site location

Roma Street Station, Roma Street Brisbane City QLD 4000

I, Christopher Mutton reasonably believe on 04-AUG-2020 at 15:20 that you are contravening a provision of the:

Work Health and Safety Act 2011 - section(s) 19(3)(B)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirm that the PC/PCBU has failed to ensure that plant (scaffold) has been maintained in a safe manner. PC/PCBU could not provide a 30day hand over certificate at the time of inspection. Increased mobile plant activities within the immediate area where there is a risk of collision with scaffold. Persons are at risk of scaffold collapsing causing injury.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

04-AUG-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 07-AUG-2020

Service method: Delivered directly to the person named

MICHAEL FINCH
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2019713

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government

Form 13 **RECIPIENT'S COPY**

Improvement notice

Notice No. I2021571

V1.3.18

Work Health and Safety Act 2011, Electrical Safety Act 2002, Safety in Recreational Water Activities Act 2011

This notice is issued under the *Work Health and Safety Act 2011* section 191, *Safety in Recreational Water Activities Act 2011* applied section 191 *Work Health and Safety Act 2011* or *Electrical Safety Act 2002* section 146. This notice requires the person (which includes a body corporate, government department or public authority) to whom it is issued to remedy a contravention of the Act or Regulations. **The legislation requires that the person to whom an improvement notice is issued must, as soon as possible, display a copy of the notice in a prominent place at or near the workplace, or part of the workplace at which work is being carried out that is affected by the notice.**

Notice issued to:

Legal name of person/business or undertaking: QUEENSLAND PRE-STRESSING PTY. LTD.

ABN: 95063541873 | ACN:

Trading as:

Address: 69 FREDRICK ST, NORTHGATE 4013 QLD

Details of contravention:

Site location

Boggo Road Station, DUTTON PARK 4102.

I, Steve Rushton reasonably believe on 04-AUG-2020 at 13:08 that you are contravening a provision of the:

Work Health and Safety Regulation 2011 - regulation 346(1)

Brief description of how the provision is being or has been contravened:

Observations, inspections, photographs and conversations with relevant persons confirmed that the PCBU has failed to ensure that the hazardous chemical (Penapatch HB50) has been maintained on the register of hazardous chemicals, so that the information in the register is up to date.

Directions (if any) as to the measures to be taken to remedy or prevent the contravention or likely contravention:
It is mandatory to comply with these directions

Recommendations (if any): It is not an offence to fail to comply with recommendations in a notice.

Issuing inspector:

[redacted]

Signature of inspector | Inspector's ID | Inspector's contact number

04-AUG-2020
Date issued

[redacted]
Inspector's location

This contravention must be remedied before: 06-AUG-2020

Service method: Delivered directly to the person named by electronic transmission

COLIN GOODALL
Notice given to

Management Representative For Person Conducting A Business Or Undertaking
Relationship to person to whom notice is issued

This portion may be signed and returned where contravention has been remedied before the stated date.
I certify that the requirements of this notice have been complied with:

Name *in block letters*: _____ Position: _____

Signature: _____ Date complied: / /

ABN 94 496 188 983

Notice No. I2021571

An inspector may make minor technical changes to this notice in certain circumstances. This does not change the validity of the notice. You must comply with this notice within the period stated. Failure to comply with this notice may incur a maximum penalty of $50,000 for an individual and $250,000 for a body corporate, government department or public authority.

PRIVACY COLLECTION STATEMENT
The Office of Industrial Relations (OIR) collects, uses, discloses and stores information in accordance with legislation it administers and all applicable privacy laws. This includes information collected by inspectors of OIR. Note that privacy laws do not apply if other laws conflict or allow or require the collection of information, and do not apply to the collection of information by OIR to the extent that it is exercising its law enforcement functions and non-compliance with privacy legislation is deemed necessary to fulfil those functions.

Queensland Government